



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓
Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵遞
e-mail wsdinfo@wsd.gov.hk

電話
Telephone 2829 4355

圖文傳真
Facsimile 2824 0578

檔號
Reference (4) in WSD 3321/17 Pt.1 T/J(240)

27 March 2017

Approval of "AVK" Check Valves

Your letter ref. AHK/L/03.15248/17/HW dated 6 March 2017 and subsequent clarification by email on 16 March 2017 refer.

It is noted that the fittings described below have been accepted by the United Kingdom Water Regulations Advisory Scheme (WRAS) to have complied with the requirements of the United Kingdom Water Supply (Water Fittings) Regulations / Scottish Water Byelaws when correctly installed.

Name of Manufacturer: AVK Valves (Anhui) Co Ltd

Country of Origin: China

Brand: AVK

Details of Fitting: AVK series 41 range of swing gate valves with epoxy coated ductile iron bodies and metal to metal seal. For vertical and horizontal installation. Maximum working pressure 16.0 bar. Maximum operating temperature 85°C. (with epoxy powder coating under WRAS approval no. 1701509)

Model: AVK Series 41

Size: 350mm, 400mm, 450mm, 500mm and 600mm

Marking: AVK, size, PN rating, direction of flow arrow and product information on body.

WRAS Approval Numbers: 1702366

Installation Requirement: R001

Expiry Date: 31 January 2022

In view of the acceptance by WRAS, this Authority has no objection to the use of the said fittings in fresh water plumbing systems, flushing water plumbing systems and fire services subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following installation requirements –

“Installation shall comply with the ‘Installation Requirements & Notes’ of the WRAS’s approval letter concerned.”

A condition of this acceptance is that the fittings to be installed should be replicas of the samples certified by WRAS and no modification should be made to the fittings. This acceptance may be withdrawn at any time if the standard of the fittings installed fail to meet that of the approved samples or if the fittings are found to be unsuitable for use in the water supply systems mentioned above.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.


Should you have any enquiries, please contact our Engineer Mr Terry KUNG at tel. no. 2294 2656.

Yours faithfully,



(CHAN Chung Kun)
for Water Authority

c.c. WSD 3321/1/82] - without catalogue
ME/MC] - with soft copy only

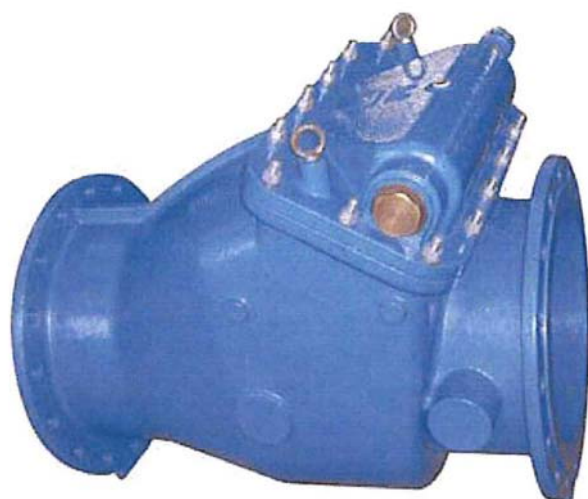

AVK SERIES 41