



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓

Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵遞
e-mail

wsdinfo@wsd.gov.hk

電話
Telephone

2829 4355

圖文傳真
Facsimile

2824 0578

檔號
Reference

(7) in WSD 3321/17 Pt.1 T/J(154)

20 April 2017

Approval of "BROEN-LAB A/S" Laboratory Taps

Your letter dated 23 February 2017 and subsequent clarification by email on 11 April 2017 refer.

It is noted that the fittings described below have been accepted by the United Kingdom Water Regulations Advisory Scheme (WRAS) to have complied with the requirements of the United Kingdom Water Supply (Water Fittings) Regulations / Scottish Water Byelaws when correctly installed.

Name of Manufacturer: Broen-Lab A/S

Country of Origin: Denmark

Brand: Broen-Lab A/S

Details of Fitting: Range of wall and deck mounted, fixed or swivel laboratory taps and mixers (powder coated brass) incorporating ceramic disc headworks, non-rising spindle headworks or ceramic cartridge headworks, with lever or dome operating members. The spout outlets incorporate an aerator, a hose union connection, or a DC pipe interrupter with hose union connection.

Maximum working pressure 10.0 bar. Maximum operating temperature 70°C

Model and Size: 2533xxx82xx-xxx – 15mm
2534xxx82xx-xxx – 15mm
2536xxx82xx-xxx – 10mm

Marking: Broen on operating member

WRAS Approval Number: 1612804

Installation Requirements: R001, R006, R010, R040, R090

Expiry Date: 31 December 2021

In view of the acceptance by WRAS, this Authority has no objection to the use of the said fittings in fresh water supply plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following installation requirements –

“Installation shall comply with the ‘Installation Requirements & Notes’ of the WRAS’s approval letter concerned.” AND

“The cold water supply to the fittings shall be drawn from the same source that supplies the hot water apparatus so as to provide a balanced pressure and to obviate the risk of scalding in the event of a restriction or failure in the water supply.”

A condition of this acceptance is that the fittings to be installed should be replicas of the samples certified by WRAS and no modification should be made to the fittings. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in fresh water supply plumbing systems.

This acceptance is only applicable to the main body of the fittings, unless other specified.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.


Should you have any enquiries, please contact our Engineer Mr Terry KUNG at tel. no. 2294 2656.

Yours faithfully,



(CHAN Chung Kun)
for Water Authority

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

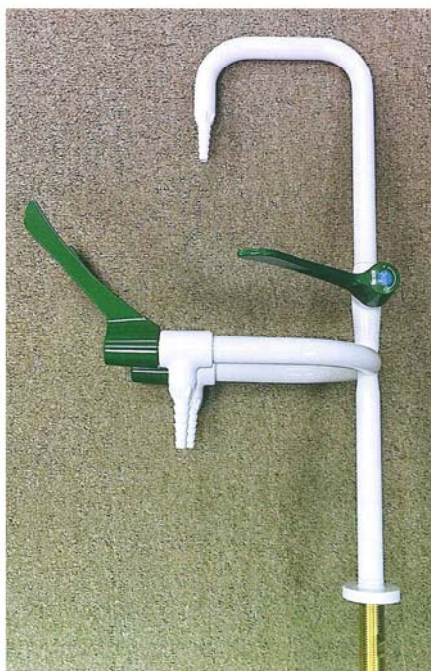

2533 xxx 82xx-xx x



2534 xxx 82xx-xx x



2536 xxx 82xx-xx x