



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓

Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵遞

e-mail

wsdinfo@wsd.gov.hk

電話

Telephone

2829 4355

圖文傳真

Facsimile

2824 0578

檔號

Reference

(4) in WSD 3321/17 Pt.1 T/J(951)

15 August 2017

Approval of "IDEAL STANDARD" Thermostatic Blending Valves

Your letter ref. L17-206 and L17-206R1 dated 12 July 2017 and 26 July 2017 respectively refer.

It is noted that the fittings described below have been accepted by the United Kingdom Water Regulations Advisory Scheme (WRAS) to have complied with the requirements of the United Kingdom Water Supply (Water Fittings) Regulations / Scottish Water Byelaws when correctly installed.

Name of Manufacturer: Ideal Standard Produktions - GmbH

Country of Origin: UK

Brand: Ideal Standard

Details of Fittings: Range of wall mounted thermostatic blending valves (chromium plated brass). Temperature and flow controlled via a single lever operating member. The inlets incorporate single check valve cartridges (suitable for backflow prevention against fluid category 2). The product is also supplied with servicing valves and in-line Y-pattern strainers. Maximum working pressure 10.0 bar. Maximum operating temperature 85°C.

Model and Size: A3101AA - 15mm compression inlets x ½" BSP male outlet
A3084AA - 15mm compression inlets x ½" BSP outlet
A3085AA - 15mm compression inlets x ½" BSP female outlet
A3102AA - ½" BSP (F) Inlets and outlet

Marking: 'IS' on operating member cap

WRAS Approval Number: 1611051

Installation Requirements: R001, R040

Expiry Date: 30 November 2021

In view of the acceptance by WRAS, this Authority has no objection to the use of the said fittings in fresh water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following installation requirements –

“Installation shall comply with the ‘Installation Requirements & Notes’ of the WRAS’s approval letter concerned.”

“The cold water supply to the fittings shall be drawn from the same source that supplies the hot water apparatus so as to provide a balanced pressure and to obviate the risk of scalding in the event of a restriction or failure in the water supply.” AND

“The shower head or handspray should not be placed in submerged conditions and should be securely fixed to the original position after use.”

A condition of this acceptance is that the fittings to be installed should be replicas of the samples certified by WRAS and no modification should be made to the fittings. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in fresh water plumbing systems.

This acceptance is only applicable to the main body of the fittings, unless other specified.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.


Should you have any enquiries, please contact our Engineer Mr Terry KUNG at tel. no. 2294 2656.

Yours faithfully,



(Roger WONG)
for Water Authority


c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

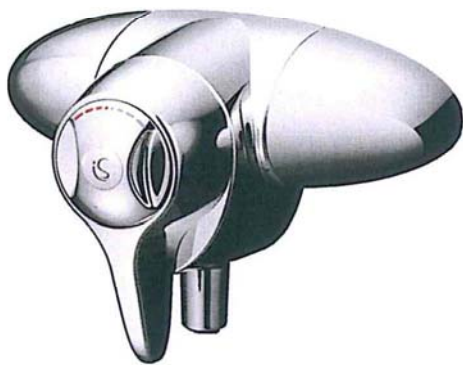

A3084AA



A3085AA

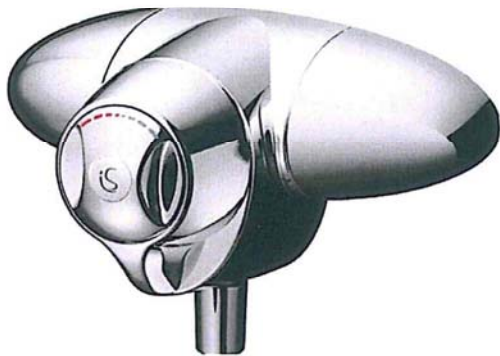

A3101AA



A3102AA

