



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓

Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵件

e-mail

wsdinfo@wsd.gov.hk

電話

Telephone

2829 4355

圖文傳真

Facsimile

2824 0578

檔號

Reference

(2) in WSD 3321/17 Pt.1 T/J(955)

15 August 2017

## Approval of "IDEAL STANDARD" Combination Tap Assembly

Your letter ref. L17-208 dated 12 July 2017 refers.

It is noted that the fitting described below has been accepted by the United Kingdom Water Regulations Advisory Scheme (WRAS) to have complied with the requirements of the United Kingdom Water Supply (Water Fittings) Regulations / Scottish Water Byelaws when correctly installed.

**Name of Manufacturer:** Ideal Standard Productions - GmbH

**Country of Origin:** UK

**Brand:** Ideal Standard

**Details of Fitting:** Deck mounted, two hole, single outlet (fixed) combination tap assembly (chromium plated brass), incorporating a quarter turn ceramic disc headwork with a dome type operating member and self-cancelling diverter. The temperature is controlled independently via a thermostatic cartridge with a dome type operating member that also incorporates a manual override button. Both inlets incorporate a single check valve cartridge (suitable for backflow protection against Fluid Category 2). The spout outlet incorporates a

plastic flow straightener. Maximum working pressure 10.0 bar. Maximum operating temperature 60°C.

**Model:** A4054AA

**Size:** ¾" BSP male

**Marking:** Ideal standard on operating member

**WRAS Approval Number:** 1702008

**Installation Requirements:** R001, R005, R010, R030

**Expiry Date:** 28 February 2022

In view of the acceptance by WRAS, this Authority has no objection to the use of the said fitting in fresh water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following installation requirements –

“Installation shall comply with the ‘Installation Requirements & Notes’ of the WRAS’s approval letter concerned.”

“The cold water supply to the fitting shall be drawn from the same source that supplies the hot water apparatus so as to provide a balanced pressure and to obviate the risk of scalding in the event of a restriction or failure in the water supply.” AND

“The shower head or handspray should not be placed in submerged conditions and should be securely fixed to the original position after use.”

A condition of this acceptance is that the fitting to be installed should be replicas of the sample certified by WRAS and no modification should be made to the fitting. This acceptance may be withdrawn at any time if the standard of the fitting installed fails to meet that of the approved sample or if the fitting is found to be unsuitable for use in fresh water plumbing systems.

This acceptance is only applicable to the main body of the fitting, unless other specified.

For the use of the fitting in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fitting by this Authority.


Should you have any enquiries, please contact our Engineer Mr Terry KUNG at tel. no. 2294 2656.

Yours faithfully,



(Roger WONG)  
for Water Authority

c.c.      WSD 3321/1/82    ] - without catalogue  
         ME/MC            ] - with soft copy only

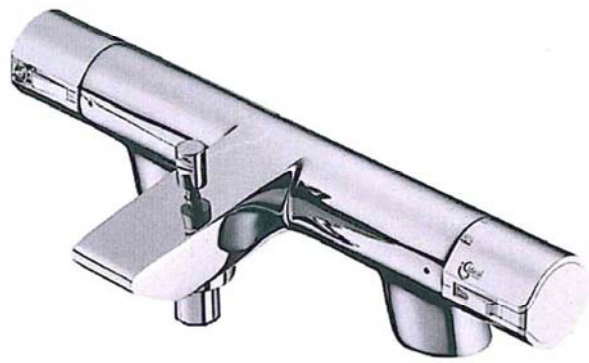

A4054AA