



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓
Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵件
e-mail wsdinfo@wsd.gov.hk

電話
Telephone 2829 4355

圖文傳真
Facsimile 2824 0578

檔號
Reference (8) in WSD 3321/17 Pt.1 T/J(1227)

1 November 2017

Approval of “DVS” Flush Valves

Your letter ref. KA/160 dated 8 September 2017 and subsequent clarification by email on 17 October 2017 refer.

It is noted that the fittings described below have been accepted by the United Kingdom Water Regulations Advisory Scheme (WRAS) to have complied with the requirements of the United Kingdom Water Supply (Water Fittings) Regulations / Scottish Water Byelaws when correctly installed.

Name of Manufacturer: Dart Valley Systems Ltd

Country of Origin: UK

Brand: DVS

Details of Fitting: Range of flush valves with plastic valve bodies, plastic valve base and silicon sponge seal. The product incorporates an internal overflow. Cold water use only.

Model: WC03

Size: 1½” & 2”

Marking: DVS, Dart valley web address, EC flushing control system, FRANKE & other tech info on adhesive label on control junction box.

WRAS Approval Number: 1710800

Installation Requirements: R001

Expiry Date: 31 October 2022

In view of the acceptance by WRAS, this Authority has no objection to the use of the said fittings in flushing water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirements –

“Installation shall comply with the ‘Installation Requirements & Notes’ of the WRAS’s approval letter concerned.”

“The flushing volume of the flushing valve should be adjusted to suit the design of the toilet bowl so that wastes can be cleared effectively by a single flush.”

“The maximum flushing cistern volume including that of dual flush cisterns for use in conjunction with the fittings shall not exceed 7.5 litres per flush.”

“The fittings should be used within the range of working pressures specified by the manufacturer.” AND

“The installed fittings should not result in backflow of water that will contaminate the flushing water supply.”

A condition of this acceptance is that the fittings to be installed should be replicas of the samples certified by WRAS and no modification should be made to the fittings. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in flushing water plumbing systems.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.


Should you have any enquiries, please contact our Engineer Mr Terry KUNG at tel. no. 2294 2656.

Yours faithfully,

A handwritten signature in black ink, appearing to read 'Chan Chung Kun', written in a cursive style.

(CHAN Chung Kun)
for Water Authority

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

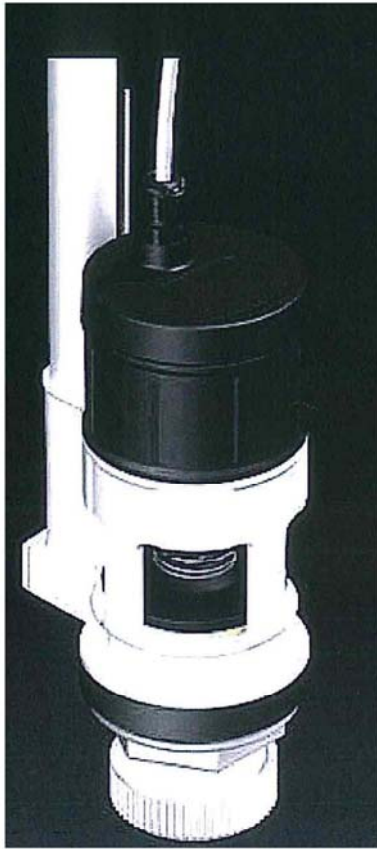

WC03