



水務署
Water Supplies Department

總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (4) in WSD 3321/19 Pt.1 T/J(60)
Our ref.
來函檔號 :
Your ref.

電話 :
Tel.
傳真 : 2824 0578
Fax.

12 March 2019

**Approval of “FANSKI” Flexible Hoses
(General Acceptance No. B20190025)**

Your letters ref. DR/WSD/TT/L/19/1/30 and DR/WSD/TT/L/19/1/37 dated 21 January 2019 and 25 January 2019 respectively refer.

It is noted that the fittings described below have been accepted by the United Kingdom Water Regulations Advisory Scheme (WRAS) to have complied with the requirements of the United Kingdom Water Supply (Water Fittings) Regulations / Scottish Water Byelaws when correctly installed.

Name of Manufacturer: Fanski Group Inc

Country of Origin: the Mainland of China

Brand: Fanski

Details of Fitting: ‘FANSKI’ Range of stainless steel braided EPDM lined flexible hose assemblies with a variety of end connections, including EPDM washers and ‘O’-rings. Operating parameters: 16.0 bar@cold water use only. 10.0 bar@85°C.

Model and Size: DG10E-UKWR-005-L (F ½" BSP x F ½" BSP)
DG10E-UKWR-029-L (F ½" x M10)
DG10E-UKWR-030-L (F ¾" x M10)

Body Markings: Fanski, WRAS and date of manufacture (YYYY) on the crimped sleeve

WRAS Approval Number: 1805055

Installation Requirements: R001

Expiry Date: 31 May 2023

In view of the acceptance by WRAS, this Authority has no objection to the use of the said fittings in fresh water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following installation requirements –

“Installation shall comply with the ‘Installation Requirements & Notes’ of the WRAS’s approval letter concerned.” AND

“The inlet flexible hose is applied for the water tap or mixer connection only and installed in the fresh water plumbing systems.”

A condition of this acceptance is that the fittings to be installed should be replicas of the samples certified by WRAS and no modification should be made to the fittings. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in fresh water plumbing systems.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,



(CHAN Chung-kun)


for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only



DG10E-UKWR-005-L

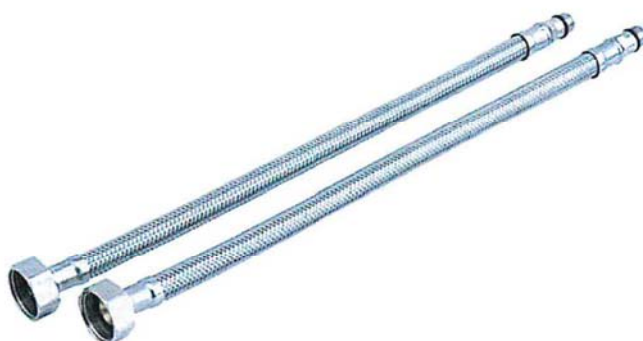

DG10E-UKWR-029L / DG10E-UKWR-030L