



水務署
Water Supplies Department

總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (2) in WSD 3321/2020 T/J(954/2020)
Our ref.
來函檔號 :
Your ref.

電話 :
Tel.
傳真 : 2824 0578
Fax.

31 August 2020

**Approval of “CALEFFI” Pressure Reducing Valve
(General Acceptance No. B20200065)**

Your letter ref. L-07718-20 dated 31 July 2020 refers.

It is noted that the fitting described below has been accepted by the United Kingdom Water Regulations Advisory Scheme (WRAS) to have complied with the requirements of the United Kingdom Water Supply (Water Fitting) Regulations / Scottish Water Byelaws when correctly installed. This Authority accepts that the fitting described below based on the WRAS certificate and test report ref. BC-SUMMARY-2020-60 issued on 27 July 2020 by Castco Testing Centre Limited complies with, and its use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Caleffi SpA

Country of Origin: Italy

Brand: Caleffi

Details of Fitting: Range of pre-set, in-line pressure reducing valve (factory pre-set at 3.0 bar) with bronze bodies, incorporating EPDM diaphragm and EPDM ‘O’-rings. Maximum inlet supply pressure 25.0 bar. Maximum operating temperature 80°C.

Model and Size: 536590 - 2"

Body Markings: , flow arrow, size, CR and DN on body. 3 bar on adhesive label on cap.

WRAS Approval Number: 1911316

Installation Requirements: R001, R120

Expiry Date: 30 November 2024

In view of the acceptance by WRAS, this Authority has no objection to the use of the said fitting in fresh water plumbing systems and fresh water fire services systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following installation requirements –

“Installation shall comply with the ‘Installation Requirements & Notes’ of the WRAS’s approval letter concerned.”

A condition of this acceptance is that the fitting to be installed should be replicas of the sample certified by WRAS and no modification should be made to the fitting. This acceptance may be withdrawn at any time if the standard of the fitting installed fails to meet that of the approved sample or if the fitting is found to be unsuitable for use in the water supply systems mentioned above.

For the use of the fitting in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fitting by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,




(CHAN Chung-kun)

for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

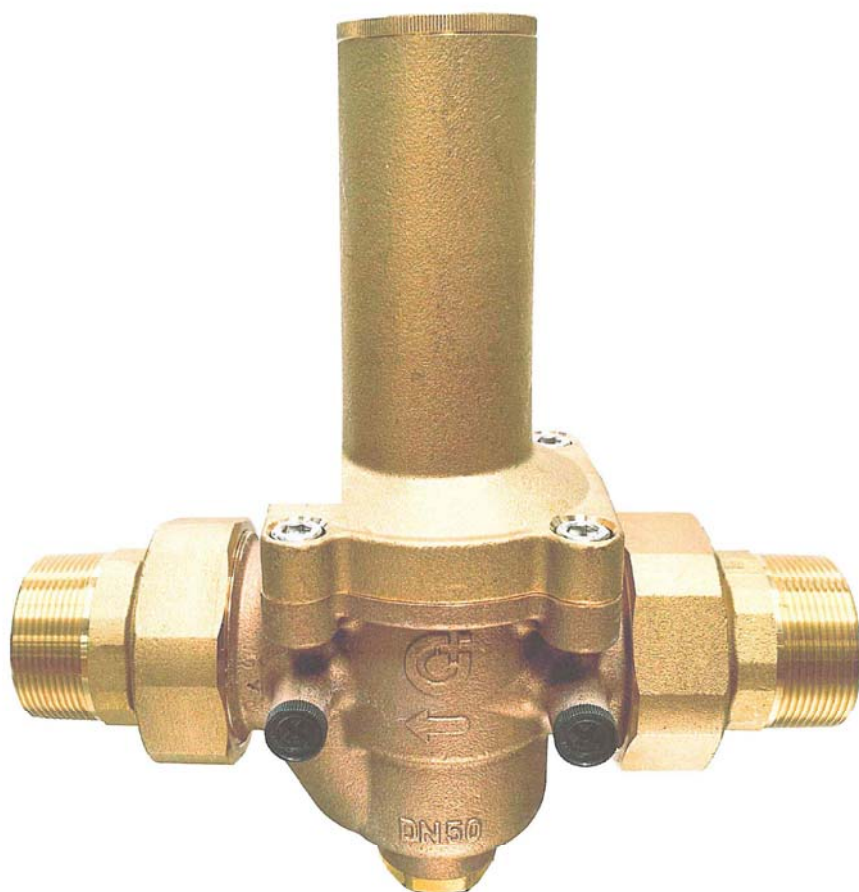

536590