



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓
Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵件
e-mail wsdinfo@wsd.gov.hk

電話
Telephone 2829 4355

圖文傳真
Facsimile 2824 0578

檔號
Reference (4) in WSD 3321/17 Pt.1 T/J(310)

21 April 2017

Approval of "ROCA" Float and Flush Valves

Your letters ref. RSL-Cert-17001 and RSL-Cert-17001R1 dated 17 March 2017 and 27 March 2017 respectively refer.

Brand	Model (size)	Fugro Test Report Ref.	Issuance Date
Roca	ZV0000080C (3/8")	162250ST161047(1)	17 Feb 2017
Roca	Z0000081C (50mm)	162250ST161047	17 Feb 2017

Having considered the above test reports issued by the Fugro Technical Services Limited, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Roca (China) Co Ltd

Country of Origin: China

Brand: Roca

Details of Fitting: 1. 3/8" Float operated valve
Model: ZV0000080C

2. 50mm Flushing valve
Model: Z0000081C

Body Markings: Nil

Expiry Date: 18 December 2021 (for ZV0000080C)
25 January 2022 (for Z0000081C)

Proviso: As the fittings have not been tested for use in contact with water intended for human consumption, the fittings can only be used in flushing water plumbing system.

This Authority hereby permits the use of the above fittings in flushing water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

"The flushing volume of the flushing valves should be adjusted to suit the design of the toilet bowl so that wastes can be cleared effectively by a single flush."

"The maximum flushing cistern volume including that of dual flush cisterns for use in conjunction with the fittings shall not exceed 7.5 litres per flush."

"The fittings should be used within the range of working pressures specified by the manufacturer." AND

"The installed fittings should not result in backflow of water that will contaminate the flushing water supply."

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in flushing water plumbing systems.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.


Should you have any enquiries, please contact our Engineer Mr Terry KUNG at tel. no. 2294 2656.

Yours faithfully,




(CHAN Chung Kun)
for Water Authority

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

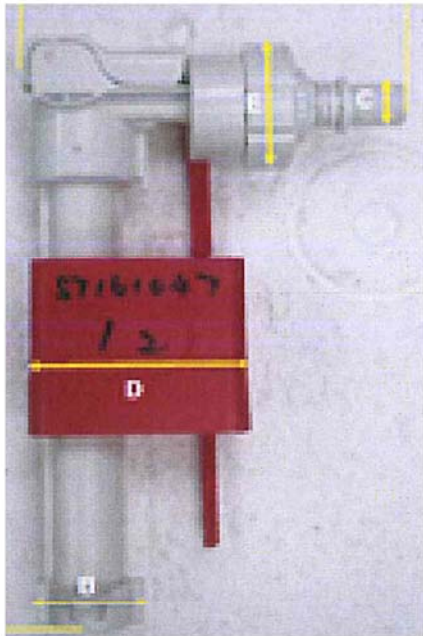

ZV0000080C

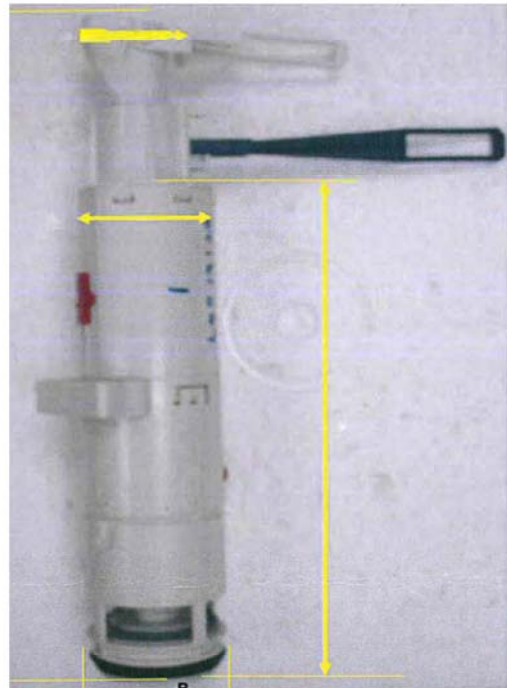

Z0000081C