



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓

Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵遞

e-mail

wsdinfo@wsd.gov.hk

電話

Telephone

2829 4355

圖文傳真

Facsimile

2824 0578

檔號

Reference

(7) in WSD 3321/17 Pt.1 T/J(345)

29 June 2017

Approval of "DMP" Sensor Flush Valves

Your letters ref. L17-033, L17-033R1 and L17-033R2 dated 29 March 2017, 25 May 2017 and 5 June 2017 respectively refer.

Having considered the test report ref. J20266r2 issued on 25 May 2017 by Nutek Systems (HK) Limited, this Authority accepts that the fittings described below complies with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: DMP Electronic Srl

Country of Origin: Italy

Brand: DMP

Details of Fittings: 1/2" Sensor flush valve for urinal

Model: FIN200
FIN200/22826
FIN200/82826
FLUSH IN 200 GLASS/32103
FLUSH IN 200 GLASS/72103
FIN200 GLASS/32853

FIN200 GLASS/72853
FIN200/22846
FIN200/82846

Body Markings



Expiry Date: 23 May 2022

Proviso: As the fittings have not been tested for use in contact with water intended for human consumption, the fittings can only be used in flushing water plumbing system.

This Authority hereby permits the use of the above fittings in flushing water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

“Installation of filter before flushing valve is required. Without the filter, the flushing valve is liable to leak. The installed filter need frequent inspection and cleaning to maintain flushing supply. Normally only public toilets with good management system for maintenance would be considered.”

“A stop cock or gate valve must be installed at the upstream of the fitting for manual isolation of water supply.”

“The design flushing volume of the flushing valve should be compatible with the toilet bowl to ensure that effective clearance can be achieved by a single flush of water.”

“Flushing valve should be used within the range of working pressures specified by the manufacturer.” AND

“Installation of electronic opening and closing sanitary tapware should also comply with the requirements of Electrical & Mechanical Services Department.”

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in flushing water plumbing systems.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.


Should you have any enquiries, please contact our Engineer Mr Terry KUNG at tel. no. 2294 2656.

Yours faithfully,




(CHAN Chung Kun)
for Water Authority

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

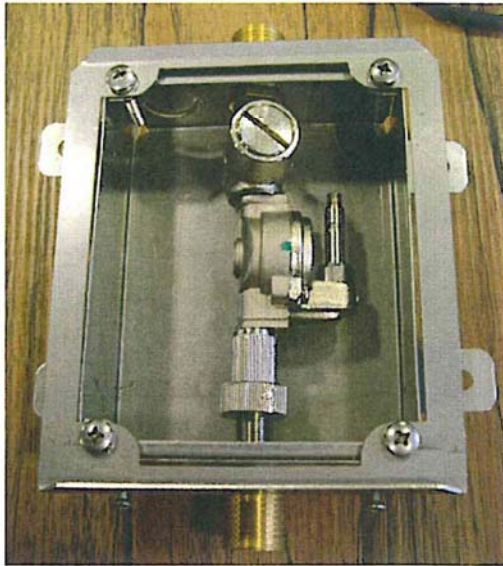

FIN200

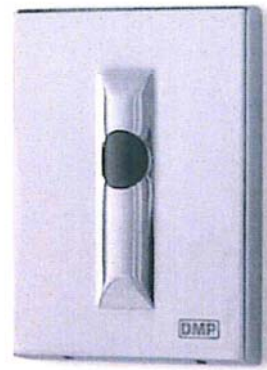

FIN200/22826 /
FIN200/82826



FLUSH IN 200 GLASS/32103 /
FLUSH IN 200 GLASS/72103



FIN200 GLASS/32853/
FIN200 GLASS/72853



FIN200/22846 /
FIN200/82846