



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓
Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵件
e-mail wsdinfo@wsd.gov.hk

電話
Telephone 2829 4355

圖文傳真
Facsimile 2824 0578

檔號
Reference (2) in WSD 3321/17 Pt.1 T/J(626)

29 June 2017

Approval of "SPENCA" Taps and Mixers

Your letter ref. KS-11382 dated 6 June 2017 refers.

Brand	Model No.	Fugro Test Report Ref.	Issuance Date
Spenca	E00-2801	165451ST161259	31 May 2017
Spenca	E00-2802B	165451ST161259(1)	31 May 2017
Spenca	E00-2809	165451ST161259(2)	31 May 2017
Spenca	E00-2803	165451ST161259(3)	1 Jun 2017
Spenca	E00-2826	165451ST161259(4)	31 May 2017

Having considered the above test reports issued by the Fugro Technical Services Limited, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Taizhou Shenhu Sanitary Co Ltd

Country of Origin: China

Brand: Spenca

Details of Fittings:

1. 1/2" Basin pillar tap
Model: E00-2801
2. 1/2" Wall mounted bib tap
Model: E00-2802B
3. 1/2" Wall mounted bath/shower mixer
Model: E00-2809
4. 1/2" Wall mounted shower mixer
Model: E00-2803
5. 1/2" Single tap of sink
Model: E00-2826

Body Markings:The logo for Spenco, featuring the word "Spenco" in a stylized, cursive font with a registered trademark symbol (®) to the upper right.**Expiry Date:**

7 February 2022 (for E00-2801)
27 March 2022 (for others)

This Authority hereby permits the use of the above fittings in fresh water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

"The cold water supply to the fittings shall be drawn from the same source that supplies the hot water apparatus so as to provide a balanced pressure and to obviate the risk of scalding in the event of a restriction or failure in the water supply." AND

"The shower head or handspray should not be placed in submerged conditions and should be securely fixed to the original position after use."

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fail to meet that of the approved samples or if the fittings are found to be unsuitable for use in the fresh water supply systems.

This acceptance is only applicable to the main body of the fittings, unless other specified.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 2294 2656.

Yours faithfully,

A handwritten signature in black ink, appearing to be 'Chan Chung Kun', written in a cursive style.

(CHAN Chung Kun)
for Water Authority

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only



E00-2801




E00-2802B



E00-2803



E00-2826

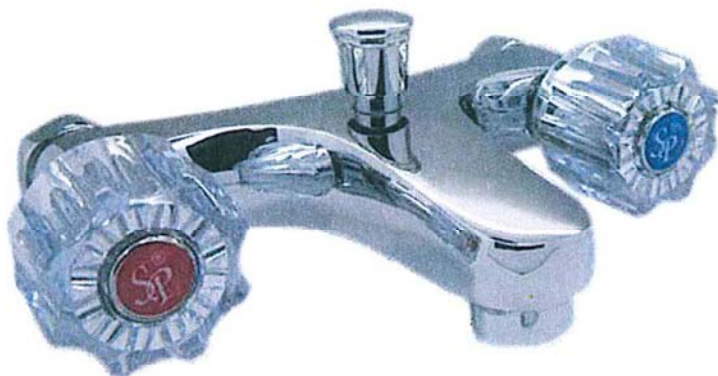

E00-2809