



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓
Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵件
e-mail wsdinfo@wsd.gov.hk

電話
Telephone 2829 4355

圖文傳真
Facsimile 2824 0578

檔號
Reference (4) in WSD 3321/17 Pt.1 T/J(863)

1 August 2017

Approval of "ROCA" Mechanical Mixers

Your letters ref. RSL-Cert-17005 and RSL-Cert-17005R1 dated 30 June 2017 and 18 July 2017 respectively refer.

Brand	Model No.	Nutek Test Report Ref.	Issuance Date
Roca	5A8460xxx	J20490	13 Apr 2017
Roca	5A3060xxx	J20492	11 May 2017
Roca	5A0160xxx	J20493	13 Apr 2017
Roca	5A3460xxx	J20496	11 May 2017

Having considered the above test reports issued by the Nutek Systems (HK) Limited, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Roca Sanitaryware (Suzhou) Co Ltd

Country of Origin: China

Brand: Roca

Details of Fittings:

1. 1/2" Single lever sink mixer
Model: 5A8460xxx
(where "xxx" denote the code of finish)
2. 1/2" Basin mixer
Model: 5A3060xxx
(where "xxx" denote the code of finish)
3. 1/2" Single lever bath/shower mixer
Model: 5A0160xxx
(where "xxx" denote the code of finish)
4. 1/2" High basin mixer
Model: 5A3460xxx
(where "xxx" denote the code of finish)

Body Markings:**Expiry Date:**

15 February 2022 (for model 5A8460xxx)
26 February 2022 (for model 5A0160xxx)
26 April 2022 (for others)

This Authority hereby permits the use of the above fittings in fresh water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

"The cold water supply to the fittings shall be drawn from the same source that supplies the hot water apparatus so as to provide a balanced pressure and to obviate the risk of scalding in the event of a restriction or failure in the water supply." AND

"The shower head or handspray should not be placed in submerged conditions and should be securely fixed to the original position after use."

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in fresh water plumbing systems.

This acceptance is only applicable to the main body of the fittings, unless other specified.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Mr Terry KUNG at tel. no. 2294 2656.

Yours faithfully,



(CHAN Chung Kun)
for Water Authority


c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only



5A8460xxx



5A3060xxx

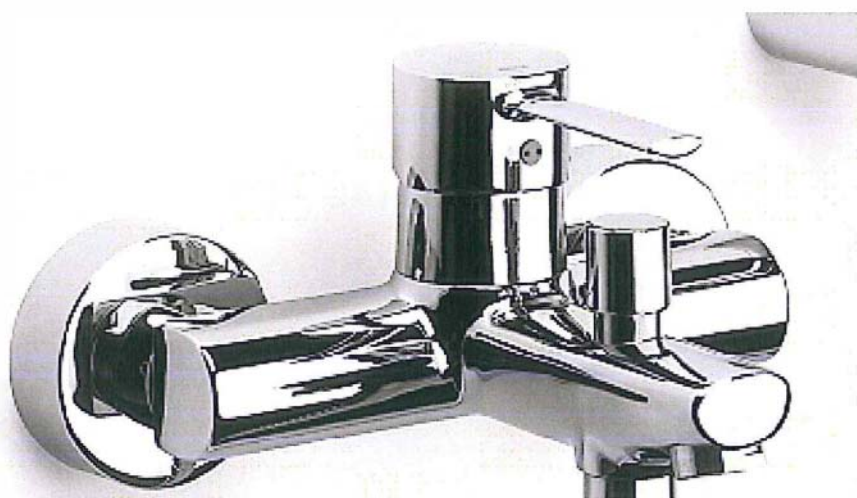

5A0160xxx



5A3460xxx