



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓  
Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵件  
e-mail wsdinfo@wsd.gov.hk

電話  
Telephone 2829 4355

圖文傳真  
Facsimile 2824 0578

檔號  
Reference (4) in WSD 3321/17 Pt.1 T/J(985)

16 October 2017

WSD/3321/17 Pt.1 T/J(985)  
WSD/3321/17 Pt.1 T/J(985)  
WSD/3321/17 Pt.1 T/J(985)  
WSD/3321/17 Pt.1 T/J(985)  
WSD/3321/17 Pt.1 T/J(985)  
WSD/3321/17 Pt.1 T/J(985)  
WSD/3321/17 Pt.1 T/J(985)

### Approval of "GROHE" Thermostatic Mixer

Your letters ref. WRC/1304 dated 17 July 2017 and ref. C-WSD/0297 dated 12 September 2017 refer.

Having considered the test report ref. J21531r1 issued on 8 September 2017 by Nutek Systems (HK) Ltd., this Authority accepts that the fitting described below complies with, and its use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

|                              |                                        |
|------------------------------|----------------------------------------|
| <b>Name of Manufacturer:</b> | Grohe AG                               |
| <b>Country of Origin:</b>    | Germany                                |
| <b>Brand:</b>                | Grohe                                  |
| <b>Details of Fitting:</b>   | 1/2" Thermostatic mixer concealed body |
| <b>Model:</b>                | 35500000                               |
| <b>Body Markings:</b>        | Nil                                    |
| <b>Expiry Date:</b>          | 1 June 2022                            |

This Authority hereby permits the use of the above fitting in fresh water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

“The cold water supply to the fitting shall be drawn from the same source that supplies the hot water apparatus so as to provide a balanced pressure and to obviate the risk of scalding in the event of a restriction or failure in the water supply.” AND

“The shower head or handspray should not be placed in submerged conditions and should be securely fixed to the original position after use.”

A condition of this acceptance is that the fitting to be installed shall be replicas of the sample as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fitting installed fails to meet that of the approved sample or if the fitting is found to be unsuitable for use in fresh water plumbing systems.

This acceptance is only applicable to the main body of the fitting, unless other specified.


For the use of the fitting in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fitting by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 2294 2656.

Yours faithfully,

  
(CHAN Chung Kun)  
for Water Authority

c.c.      WSD 3321/1/82    ] - without catalogue  
             ME/MC            ] - with soft copy only

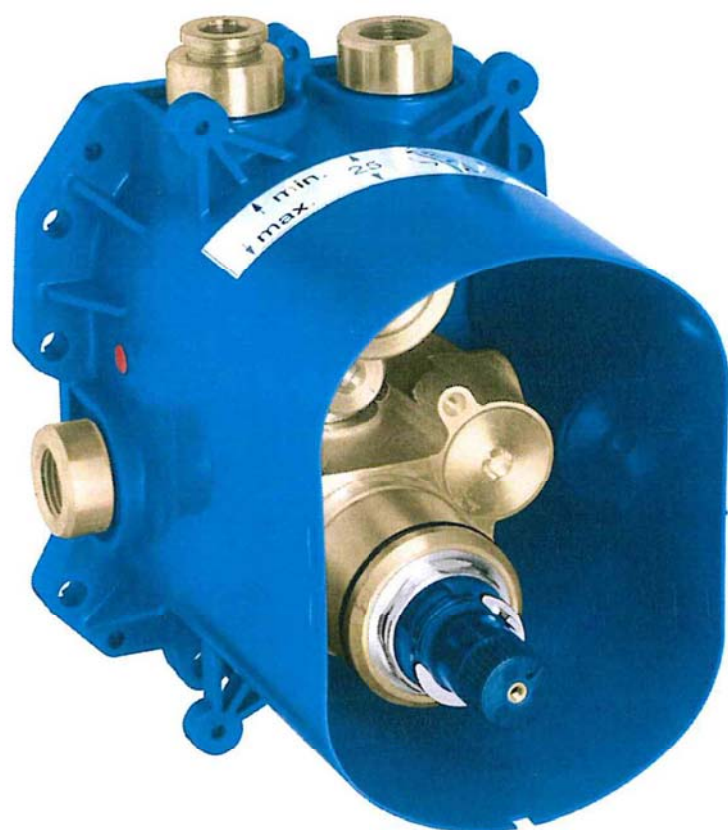

35500000