



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓
Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵件
e-mail wsdinfo@wsd.gov.hk

電話
Telephone 2829 4355

圖文傳真
Facsimile 2824 0578

檔號
Reference (2) in WSD 3321/17 Pt.1 T/J(1367)

17 November 2017

Approval of "WELSON" Float Operated Valves

Your letter ref. 2001SW-AP10232017 dated 23 October 2017 refers.

Brand	Model No. (Size)	Fugro Test Report Ref.	Issuance Date
Welson	2001SW-20 (20mm)	172926ST170590	11 Oct 2017
Welson	2001SW-25 (25mm)	172926ST170590(1)	11 Oct 2017
Welson	2001SW-32 (32mm)	172926ST170590(2)	11 Oct 2017
Welson	2001SW-40 (40mm)	172926ST170590(3)	11 Oct 2017
Welson	2001SW-50 (50mm)	172926ST170590(4)	11 Oct 2017
Welson	2001SW-65 (65mm)	172926ST170590(5)	11 Oct 2017
Welson	2001SW-80 (80mm)	172926ST170590(6)	11 Oct 2017
Welson	2001SW-100 (100mm)	172926ST170590(7)	11 Oct 2017

Having considered the above test reports issued by the Fugro Technical Services Limited, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Welson Metal & Sanitary Ware MFY

Country of Origin: China

Brand: Welson

Details of Fittings: Piston type float operated bronze valve

Model and Size: 2001SW-20 - 20mm
2001SW-25 - 25mm
2001SW-32 - 32mm
2001SW-40 - 40mm
2001SW-50 - 50mm
2001SW-65 - 65mm
2001SW-80 - 80mm
2001SW-100 - 100mm

Body Markings: WELSON size in inch

Expiry Date: 7 July 2022

Proviso: As the fittings have not been tested for use in contact with water intended for human consumption, the fittings can only be used in flushing water plumbing system.

This Authority hereby permits the use of the above fittings in flushing water plumbing systems subject to full adherence to Waterworks installation requirements.

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fail to meet that of the approved samples or if the fittings are found to be unsuitable for use in the flushing water plumbing systems.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.


Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 2294 2656.

Yours faithfully,



(CHAN Chung Kun)
for Water Authority

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

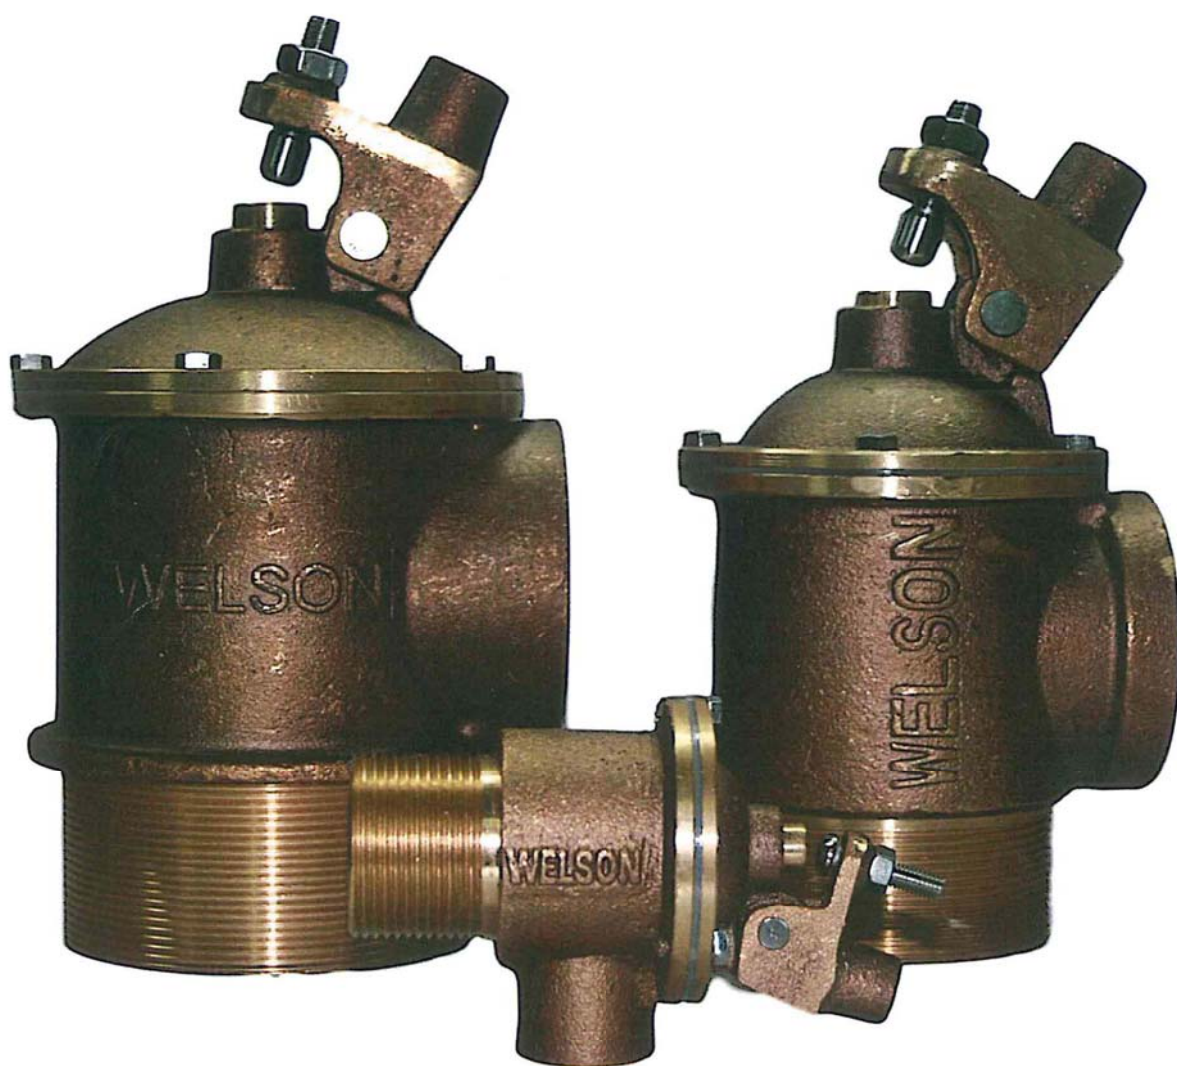

2001SW-20 / 2001SW-25 / 2001SW-32
2001SW-40 / 2001SW-50 / 2001SW-65
2001SW-80 / 2001SW-100