



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓  
Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵件  
e-mail [wsdinfo@wsd.gov.hk](mailto:wsdinfo@wsd.gov.hk)

電話  
Telephone 2829 4355

圖文傳真  
Facsimile 2824 0578

檔號  
Reference (2) in WSD 3321/17 Pt.1 T/J(1500)

5 January 2018

### Approval of "TOYO" Gate Valves

Your letter ref. GWL/17/1208 dated 8 December 2017 refers.

Having considered the test report ref. BC-SUMMARY-2017-122 issued on 21 November 2017 by Castco Testing Centre Ltd., this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

|                              |                                      |
|------------------------------|--------------------------------------|
| <b>Name of Manufacturer:</b> | Kitz Corporation of Jiangsu Kun Shan |
| <b>Country of Origin:</b>    | China                                |
| <b>Brand:</b>                | Toyo                                 |
| <b>Details of Fitting:</b>   | Carbon steel gate valve              |
| <b>Model:</b>                | Fig. 722A                            |
| <b>Size:</b>                 | 65mm, 80mm, 100mm, 150mm             |
| <b>Body Markings:</b>        | TOYO size in inch 300 WCB            |

**Expiry Date:**

16 November 2022

**Proviso:** The fittings can only be used in fresh water fire service plumbing systems.

This Authority hereby permits the use of the above fittings in fresh water fire service plumbing systems subject to full adherence to Waterworks installation requirements.

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fail to meet that of the approved samples or if the fittings are found to be unsuitable for use in fresh water fire service plumbing systems.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.


Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 2294 2656.

Yours faithfully,



(CHAN Chung Kun)  
for Water Authority

c.c.      WSD 3321/1/82   ] - without catalogue  
            ME/MC         ] - with soft copy only

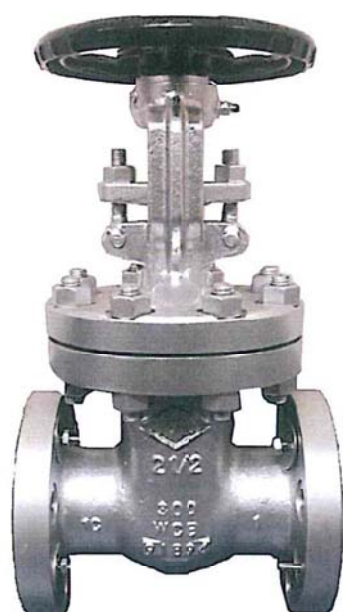

**Fig. 722A**