



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓

Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵遞

e-mail

wsdinfo@wsd.gov.hk

圖文傳真

Facsimile

2824 0578

檔 號

Reference

(2) in WSD 3321/18 Pt.1 T/J(313)

24 April 2018

Approval of “AMERICAN STANDARD” Shower Control Valves

Your letter ref. WRC/1675 dated 23 March 2018 refers.

Having considered the test report ref. J21703 issued on 12 February 2018 by Nutek Systems (HK) Ltd., this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: American Standard

Country of Origin: China

Brand: American Standard

Details of Fittings: 1/2" Concealed shower control valve

Model:
FFAS0925-709500BC0
FFAS0926-709500BC0
FFAS0927-709500BC0
FFAS0928-709500BC0

Body Markings: *American
Standard*

Expiry Date:

1 August 2022

This Authority hereby permits the use of the above fittings in fresh water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

“The cold water supply to the fittings shall be drawn from the same source that supplies the hot water apparatus so as to provide a balanced pressure and to obviate the risk of scalding in the event of a restriction or failure in the water supply.” AND

“The shower head or handspray should not be placed in submerged conditions and should be securely fixed to the original position after use.”

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in fresh water plumbing systems.

This acceptance is only applicable to the main body of the fittings, unless other specified.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.


Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,




(CHAN Chung Kun)
for Water Authority


c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

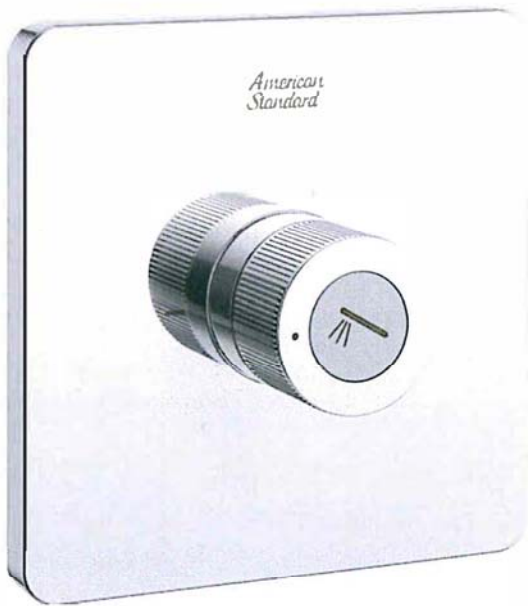

FFAS0925-709500BC0

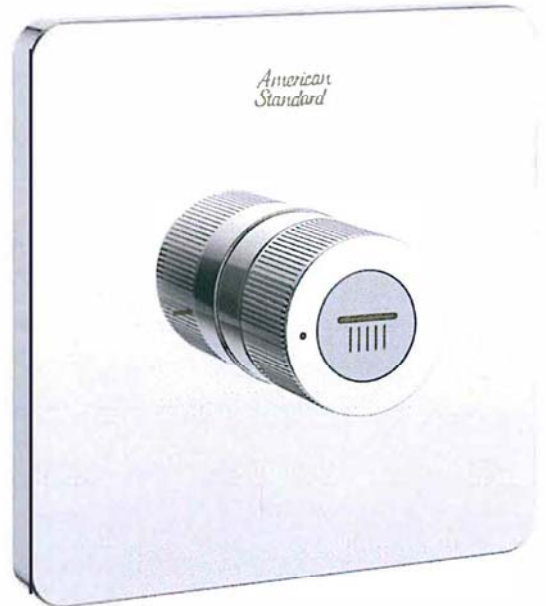

FFAS0926-709500BC0

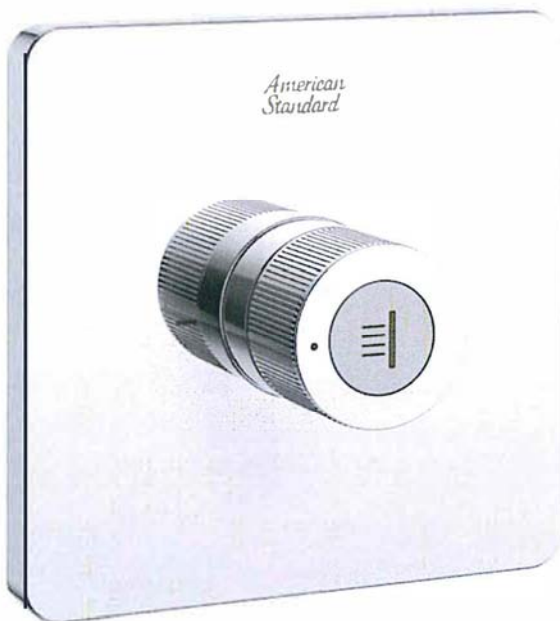

FFAS0927-709500BC0



FFAS0928-709500BC0