



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓
Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵遞
e-mail wsdinfo@wsd.gov.hk

圖文傳真
Facsimile 2824 0578

檔 號
Reference (8) in WSD 3321/17 Pt.1 T/J(1439)

16 May 2018

Approval of “KOHLER” Bath & Shower Mixers

Your letter ref. 20171116 dated 16 November 2017 and subsequent submission received by this department on 13 April 2018 refer.

Brand	Model No.	Fugro Test Report Ref.	Issuance Date
Kohler	K-72669K-XX-YY	172350ST170457B	26 Mar 2018
Kohler	K-72667K-XX-YY	172350ST170457(1)B	26 Mar 2018
Kohler	K-7686K-XX-YY	172350ST170457(8)B	26 Mar 2018
Kohler	K-72282K-XX-YY	172350ST170457(12)B	26 Mar 2018

Having considered the above test reports issued by the Fugro Technical Services Limited, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Kohler

Country of Origin: China

Brand: Kohler

- Details of Fitting:**
1. 1/2" Single lever shower mixer
Model: K-72669K-XX-YY
(where "XX" denote the codes of handle, "YY" denote the codes of finish)
 2. 1/2" Single lever bath & shower mixer
Model: K-72667K-XX-YY, K-7686K-XX-YY & K-72282K-XX-YY
(where "XX" denote the codes of handle, "YY" denote the codes of finish)

Body Markings: Kohler

Expiry Date: 26 June 2022 (for model K-7686K-XX-YY)
22 June 2022 (for others)

This Authority hereby permits the use of the above fittings in fresh water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

"The cold water supply to the fittings shall be drawn from the same source that supplies the hot water apparatus so as to provide a balanced pressure and to obviate the risk of scalding in the event of a restriction or failure in the water supply." AND

"The shower head or handspray should not be placed in submerged conditions and should be securely fixed to the original position after use."

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in fresh water plumbing systems.

This acceptance is only applicable to the main body of the fittings, unless other specified.

For the use of the fittings in any project, the Acceptance Reference Number at the bottom of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.


Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,


A handwritten signature in black ink, appearing to be 'mh' followed by a long horizontal stroke.

(CHAN Chung Kun)
for Water Authority


c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

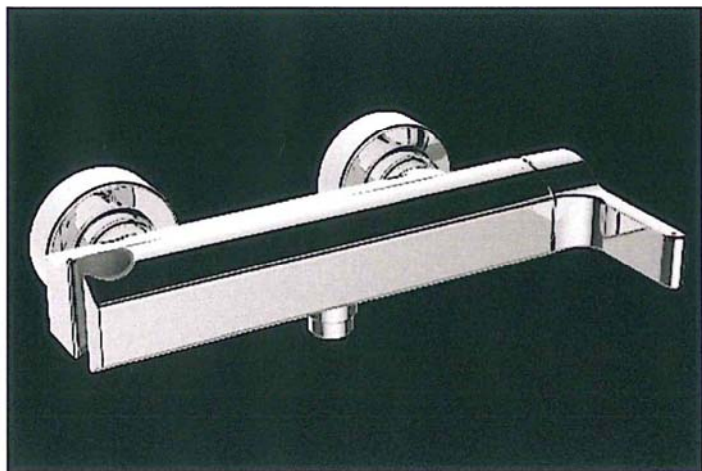


K-72669K-XX-YY

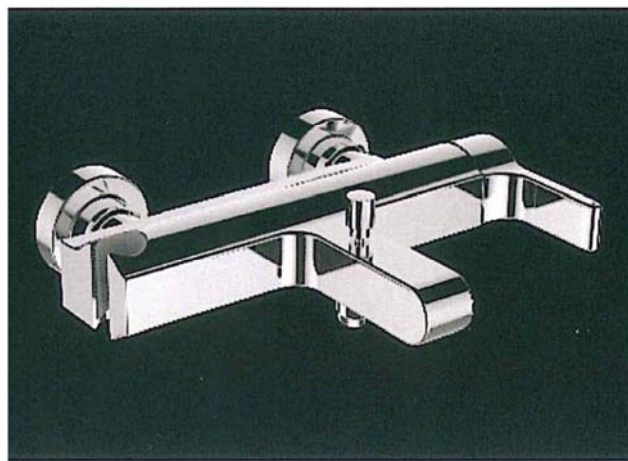

K-72667K-XX-YY

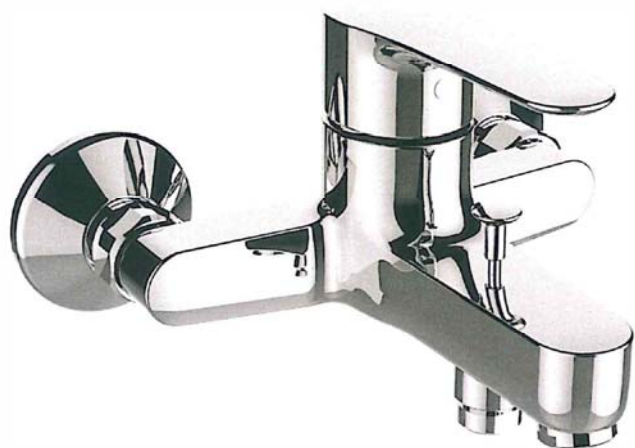

K-7686K-XX-YY

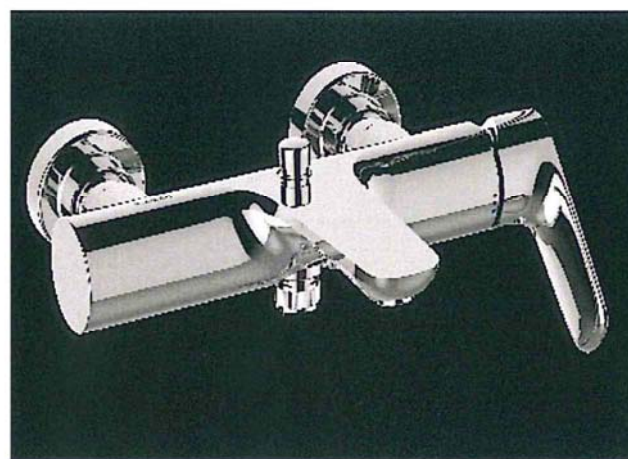

K-72282K-XX-YY