



總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (9) in WSD 3321/18 Pt.1 T/J(82)
Our ref.
來函檔號 :
Your ref.

電話 :
Tel.
傳真 : 2824 0578
Fax.

6 July 2018

Approval of "HANSA" Mechanical Mixers (General Acceptance No. C20180380)

Your letter ref. SL20180120 dated 20 January 2018 and subsequent clarification by email on 19 June 2018 refer.

Brand	Model No.	Fugro Test Report Ref.	Issuance Date
Hansa	44000000	173027ST170929A	11 Apr 2018
Hansa	44860020	173027ST170929(1)A	11 Apr 2018
Hansa	57092201	173027ST170929(2)B	11 Apr 2018
Hansa	57152201	173027ST170929(3)A	11 Apr 2018
Hansa	09092285	173027ST170929(7)A	11 Apr 2018
Hansa	09742185	173027ST170929(8)A	11 Apr 2018
Hansa	51012273	173027ST170929(12)A	11 Apr 2018

Having considered the above test reports issued by the Fugro Technical Services Limited, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Hansa Metallwerke AG

Country of Origin: Germany

Brand: Hansa

Details of Fitting:

Model No.	Product Description
44000000	1/2" Concealed basin mixer
44860020	1/2" Concealed bath mixer
57092201	3/8" Single lever basin mixer
57152201	3/8" Single lever basin mixer
09092285	3/8" Single lever basin mixer
09742185	1/2" Single lever bath mixer
51012273	3/8" Single lever sink mixer

Body Markings: For model 44000000 and 44860020:
Nil

For other models:
HANSA

Expiry Date: 6 November 2022

This Authority hereby permits the use of the above fittings in fresh water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

"The cold water supply to the fittings shall be drawn from the same source that supplies the hot water apparatus so as to provide a balanced pressure and to obviate the risk of scalding in the event of a restriction or failure in the water supply." AND

"The shower head or handspray should not be placed in submerged conditions and should be securely fixed to the original position after use."

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in fresh water plumbing systems.

This acceptance is only applicable to the main body of the fittings, unless other specified.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,

A handwritten signature in black ink, appearing to be 'Chan Chung-kun', written in a cursive style.

(CHAN Chung-kun)

for Director of Water Supplies

Encl.


c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only



44000000



57092201

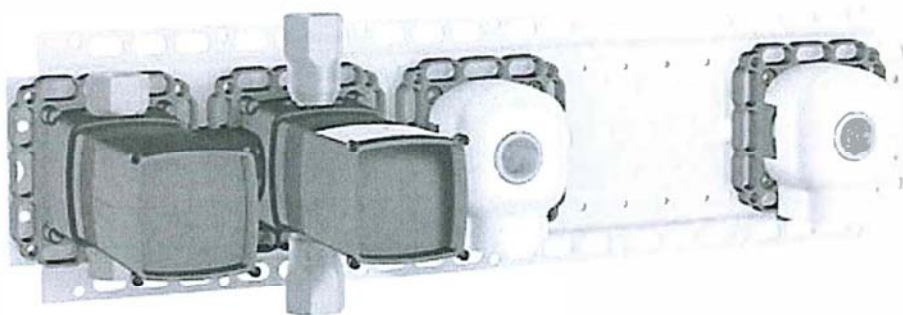


44860020




57152201



09092285

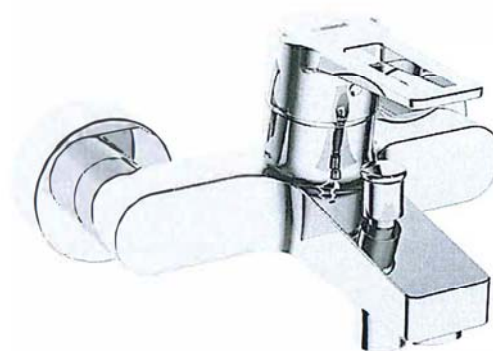

09742185

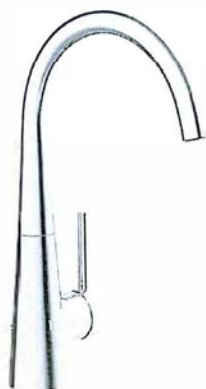

51012273