



水務署
Water Supplies Department

總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (2) in WSD 3321/18 Pt.1 T/J(1408)
Our ref.
來函檔號 :
Your ref.

電話 :
Tel.
傳真 : 2824 0578
Fax.

22 January 2019

**Approval of “HW” Globe Valves
(General Acceptance No. C20190069)**

Your letter dated 20 December 2018 refers.

Brand	Model No.	Fugro Test Report Ref.	Issuance Date
HW	HWJ11W-16RDN15	182537PC180059	17 Dec 2018
HW	HWJ11W-16RDN20	182537PC180059(1)	17 Dec 2018
HW	HWJ11W-16RDN25	182537PC180059(2)	17 Dec 2018
HW	HWJ11W-16RDN32	182537PC180059(3)	17 Dec 2018
HW	HWJ11W-16RDN40	182537PC180059(4)	17 Dec 2018
HW	HWJ11W-16RDN50	182537PC180059(5)	17 Dec 2018
HW	HWJ41W-16RDN65	182537PC180059(6)	17 Dec 2018
HW	HWJ41W-16RDN80	182537PC180059(7)	17 Dec 2018
HW	HWJ41W-16RDN100	182537PC180059(8)	17 Dec 2018
HW	HWJ41W-16RDN150	182537PC180059(9)	17 Dec 2018

Having considered the above test reports issued by the Fugro Technical Services Limited, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Hopewell Building Materials Co Ltd

Country of Origin: the Mainland of China



Brand: HW

Details of Fittings: Stainless steel globe valve

Model and Size: HWJ11W-16RDN15 – 15mm
 HWJ11W-16RDN20 – 20mm
 HWJ11W-16RDN25 – 25mm
 HWJ11W-16RDN32 – 32mm
 HWJ11W-16RDN40 – 40mm
 HWJ11W-16RDN50 – 50mm
 HWJ41W-16RDN65 – 65mm
 HWJ41W-16RDN80 – 80mm
 HWJ41W-16RDN100 – 100mm
 HWJ41W-16RDN150 – 150mm

Body Markings: For size 15mm to 50mm:
 HW size in DN ➡ CF8M

For size 65mm to 150mm:
 HW 316 size in DN ➡ 16

Expiry Date: 11 September 2023

This Authority hereby permits the use of the above fittings in fresh water plumbing systems and fresh water fire services systems subject to full adherence to Waterworks installation requirements.

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fail to meet that of the approved samples or if the fittings are found to be unsuitable for use in the water supply systems mentioned above.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.


Yours faithfully,


 (CHAN Chung-kun)


for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

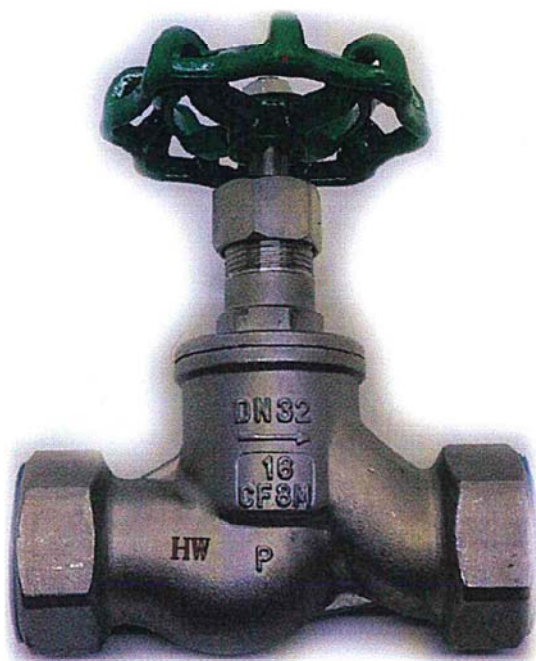

HW.J11W-16RDN15 / HW.J11W-16RDN20 /
 HW.J11W-16RDN25 / HW.J11W-16RDN32 /
 HW.J11W-16RDN40 / HW.J11W-16RDN50

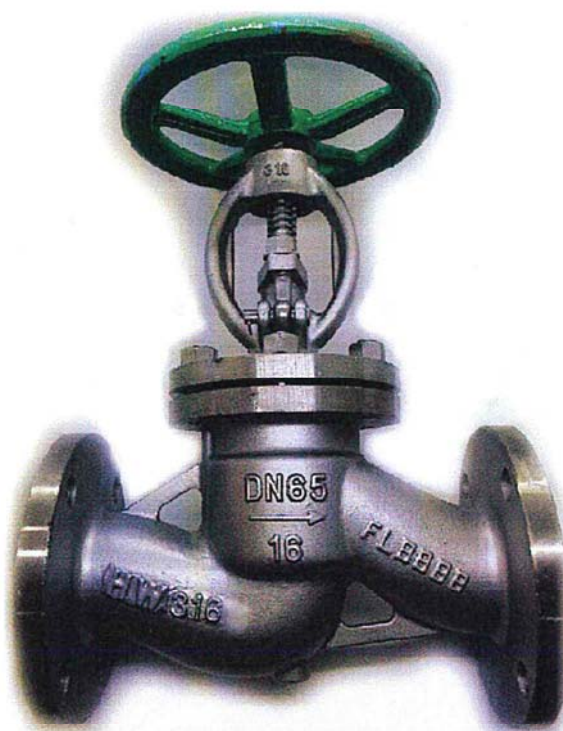

HWJ41W-16RDN65 / HWJ41W-16RDN80 /
 HWJ41W-16RDN100 / HWJ41W-16RDN150