



水務署
Water Supplies Department

總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (7) in WSD 3321/18 Pt.1 T/J(1260)
Our ref.
來函檔號 :
Your ref.

電話 :
Tel.
傳真 : 2824 0578
Fax.

19 February 2019

**Approval of "SIAMP" Float and Flush Valves
(General Acceptance No. C20190132F)**

Your letters dated 12 November 2018, 29 November 2018 and 11 January 2019 refer.

Brand	Model	Fugro Test Report Ref.	Issuance Date
Siamp	99T	183085ST180463A	11 Jan 2019
Siamp	80PN	183085ST180463(1)A	11 Jan 2019
Siamp	Mecanisme 80	183085ST180463(2)A	11 Jan 2019

Having considered the above test reports issued by Fugro Technical Services Limited, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Siamp Ltd

Country of Origin: Vietnam

Brand: Siamp

Details of Fitting:

1. ½" Float operated valve
Model: 99T
2. 1½" Dual flush valve
Model: 80PN

3. 2" Dual flush valve
Model: Mecanisme 80

Body Markings: SIAMP W (for model 99T)
Nil (for others)

Expiry Date: 30 October 2023 (for model 99T)
29 October 2023 (for others)

Proviso: As the fittings have not been tested for use in contact with water intended for human consumption, the fittings can only be used in flushing water plumbing system.

This Authority hereby permits the use of the above fittings in flushing water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

"The flushing volume of the flushing valves should be adjusted to suit the design of the toilet bowl so that wastes can be cleared effectively by a single flush."

"The maximum flushing cistern volume including that of dual flush cisterns for use in conjunction with the fitting shall not exceed 7.5 litres per flush."

"The fittings should be used within the range of working pressures specified by the manufacturer." AND

"The installed fittings should not result in backflow of water that will contaminate the flushing water supply."

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in flushing water plumbing systems.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,




(CHAN Chung-kun)


for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

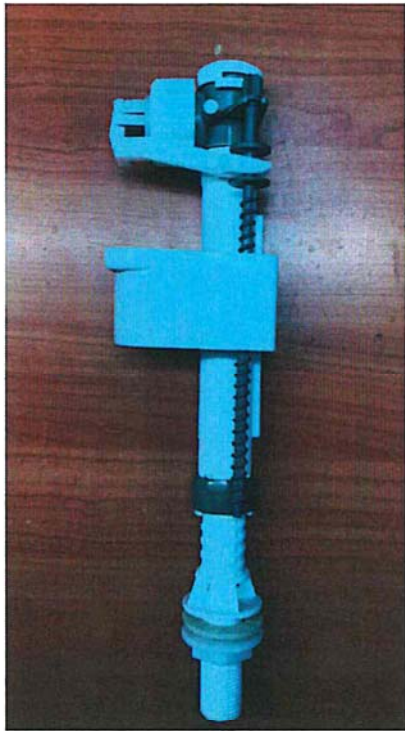

99T

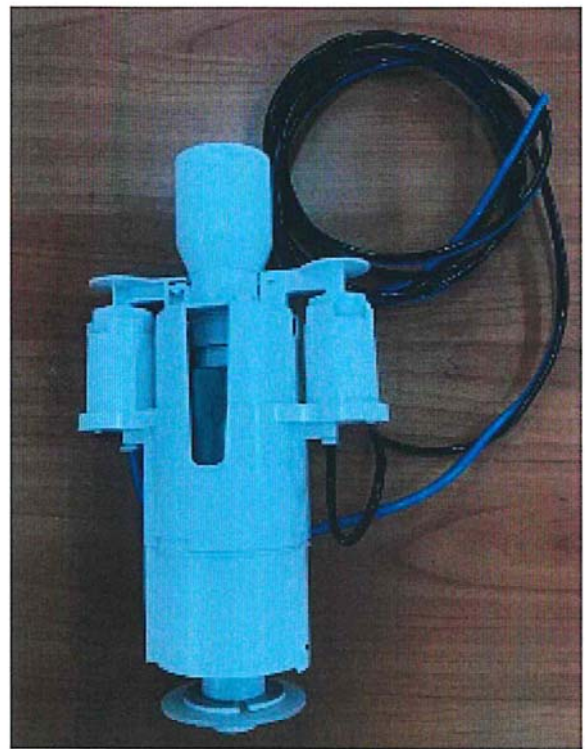

80PN



Mecanisme 80