



水務署
Water Supplies Department

總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (4) in WSD 3321/19 Pt.1 T/J(11)
Our ref.
來函檔號 :
Your ref.

電話 :
Tel.
傳真 : 2824 0578
Fax.

7 March 2019

**Approval of “TOZEN” Settlement Joints
(General Acceptance No. C20190166)**

Your letters ref. TLL/M818/19 dated 4 January 2019 and ref. TLL/M819/19 dated 15 February 2019 refer.

Brand	Model No. (Size)	Nutek Test Report Ref.	Issuance Date
Tozen	BJ-7200 (20mm)	J22924A	31 Dec 2018
Tozen	BJ-7200 (25mm)	J22924B	31 Dec 2018
Tozen	BJ-7200 (32mm)	J22924C	31 Dec 2018
Tozen	BJ-7200 (40mm)	J22924D	31 Dec 2018
Tozen	BJ-7200 (50mm)	J22924E	31 Dec 2018
Tozen	BJ-7200 (65mm)	J22924F	31 Dec 2018
Tozen	BJ-7200 (80mm)	J22924G	31 Dec 2018
Tozen	BJ-7200 (100mm)	J22924H	31 Dec 2018
Tozen	BJ-7200 (125mm)	J22924I	31 Dec 2018
Tozen	BJ-7200 (150mm)	J22924J	31 Dec 2018
Tozen	BJ-7200 (200mm)	J22924K	31 Dec 2018
Tozen	BJ-7200 (250mm)	J22924L-1	31 Dec 2018
Tozen	BJ-7200 (300mm)	J22924M-1	31 Dec 2018

Having considered the above test reports issued by the Nutek Systems (HK) Limited, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer:	Tozen Corporation
Country of Origin:	Thailand
Brand:	Tozen
Details of Fitting:	Stainless steel settlement joint
Model:	BJ-7200
Size:	20mm, 25mm, 32mm, 40mm, 50mm, 65mm, 80mm, 100mm, 125mm, 150mm, 200mm, 250mm, 300mm
Body Markings:	For size 20mm to 32mm: PN16 size in inch For size 40mm to 200mm & 300mm: TR SS400 DIN PN16 size in inch For size 250mm: EH DIN PN16 RF 10
Expiry Date:	4 December 2023

This Authority hereby permits the use of the above fittings in fresh water plumbing systems and fresh water fire services systems subject to full adherence to Waterworks installation requirements.

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fail to meet that of the approved samples or if the fittings are found to be unsuitable for use in the water supply systems mentioned above.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,





(CHAN Chung-kun)

for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

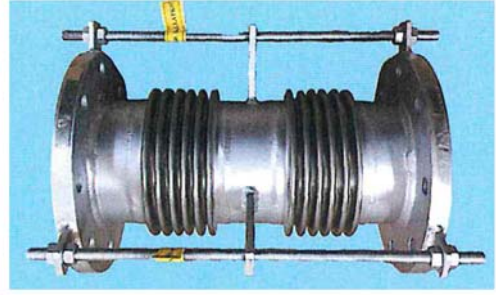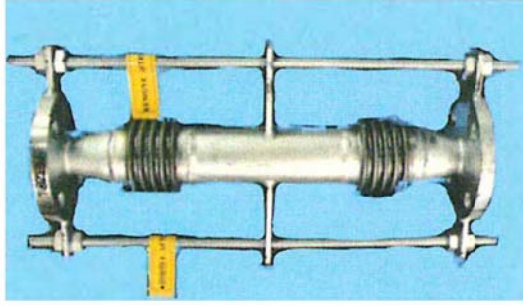

BJ-7200