



水務署
Water Supplies Department

總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (14) in WSD 3321/18 Pt.1 T/J(1175)
Our ref.
來函檔號 :
Your ref.

電話 :
Tel.
傳真 : 2824 0578
Fax.

8 March 2019

**Approval of “YK” Mechanical Mixers
(General Acceptance No. C20190171)**

Your letter dated 15 October 2018 and subsequent submission received by this department on 28 February 2019 refer.

Brand	Model No.	Fugro Test Report Ref.	Issuance Date
YK	YK15	183044PC180021(1)B	21 Jan 2019
YK	YK25	183044PC180021(2)	8 Oct 2018
YK	YK35	183044PC180021(3)	8 Oct 2018
YK	YK36	183044PC180021	8 Oct 2018

Having considered the above test reports issued by Fugro Technical Services Ltd., this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Ming Kee Factory

Country of Origin: the Mainland of China

Brand: YK

Details of Fitting: 1. 3/8" Single lever sink mixer
Model: YK15

2. 3/8" Single lever basin mixer
Model: YK25
3. 1/2" Single lever shower mixer
Model: YK35
4. 1/2" Single lever bath and shower mixer
Model: YK36

Body Markings: YK

Expiry Date: 22 November 2023 (for model YK15)
27 September 2023 (for others)

This Authority hereby permits the use of the above fittings in fresh water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

"The cold water supply to the fittings shall be drawn from the same source that supplies the hot water apparatus so as to provide a balanced pressure and to obviate the risk of scalding in the event of a restriction or failure in the water supply." AND

"The shower head or handspray should not be placed in submerged conditions and should be securely fixed to the original position after use."

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in fresh water plumbing systems.

This acceptance is only applicable to the main body of the fittings, unless other specified.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,



(CHAN Chung-kun)

for Director of Water Supplies

Encl.


c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only




YK15



YK25

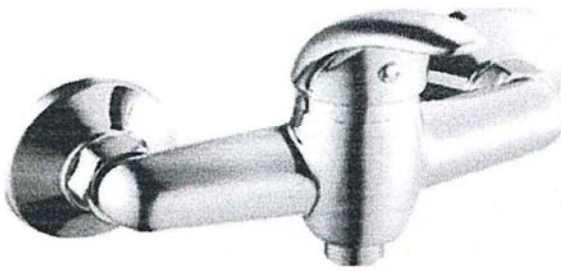

YK35

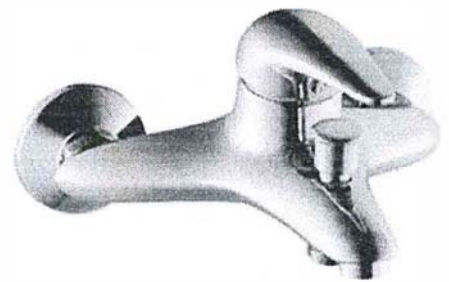

YK36