



水務署
Water Supplies Department

總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (6) in WSD 3321/19 T/J(782/2019)
Our ref.
來函檔號 :
Your ref.

電話 :
Tel.
傳真 : 2824 0578
Fax.

24 October 2019

**Approval of “SINO-FLEX” Settlement Joints
(General Acceptance No. C20190518)**

Your letters ref. 806/2019, 844/2019 and 910/2019 dated 5 August 2019, 19 August 2019 and 4 September 2019 respectively refer.

Brand	Model No. (Size)	Fugro Test Report Ref.	Issuance Date
Sino-Flex	SFSJ (75mm)	192953PC190222A	28 Aug 2019
Sino-Flex	SFSJ (100mm)	192953PC190222(1)A	28 Aug 2019
Sino-Flex	SFSJ (150mm)	192953PC190222(2)A	28 Aug 2019
Sino-Flex	SFSJ (200mm)	192953PC190222(3)A	28 Aug 2019
Sino-Flex	SFSJ (250mm)	192953PC190222(4)A	28 Aug 2019
Sino-Flex	SFSJ (300mm)	192953PC190222(5)A	28 Aug 2019
Sino-Flex	SFSJ (350mm)	192953PC190222(6)A	28 Aug 2019
Sino-Flex	SFSJ (400mm)	192953PC190222(7)A	28 Aug 2019
Sino-Flex	SFSJ (450mm)	192953PC190222(8)A	28 Aug 2019
Sino-Flex	SFSJ (500mm)	192953PC190222(9)A	28 Aug 2019
Sino-Flex	SFSJ (600mm)	192953PC190222(10)A	28 Aug 2019

Having considered the above test reports issued by the Fugro Technical Services Limited and WRAS certificate, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Shye Kuang Valves Mfg Co Ltd

Country of Origin: Taiwan, China

Brand: Sino-Flex

Details of Fitting: Ductile iron settlement joint with epoxy powder coating under WRAS approval no. 1701509

Model: SFSJ

Size: 75mm, 100mm, 150mm, 200mm, 250mm, 300mm, 350mm, 400mm, 450mm, 500mm, 600mm

Body Markings: SINO-FLEX size ± 200 mm

Expiry Date: 31 January 2022

This Authority hereby permits the use of the above fittings in fresh water plumbing systems and fresh water fire services systems subject to full adherence to Waterworks installation requirements.

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fail to meet that of the approved samples or if the fittings are found to be unsuitable for use in the water supply systems mentioned above.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,

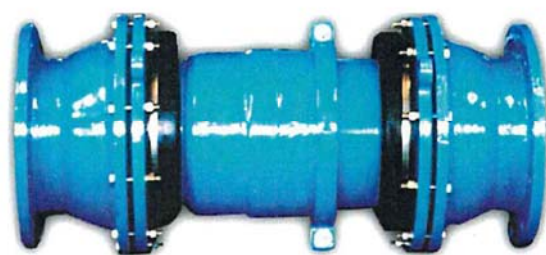

 (CHAN Chung-kun)

for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

General Acceptance No. C20190518



SFSJ