



水務署
Water Supplies Department

總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (2) in WSD 3321/19 T/J(1212/2019)
Our ref.
來函檔號 :
Your ref.

電話 :
Tel.
傳真 : 2824 0578
Fax.

18 February 2020

1. 本署已收到貴署於 2019 年 12 月 30 日發出的來函，有關「DORNBRAUCHT」品牌之「Thermostatic Control Valve」之一般接受編號 C20200099。

2. 本署已考慮到貴署於 2019 年 12 月 20 日發出的測試報告，編號 190739PC190188，該報告指出該產品符合水務條例及規例之要求。

3. 本署現已接受該產品，並同意其在水務工程中使用。

4. 本署將向有關部門發出通知，以確保該產品之安全使用。

**Approval of “DORNBRAUCHT” Thermostatic Control Valve
(General Acceptance No. C20200099)**

Your letter ref. D73A/2019/0794 dated 30 December 2019 refers.

Having considered the test report ref. 190739PC190188 issued on 20 December 2019 by Fugro Technical Services Limited, this Authority accepts that the fitting described below complies with, and its use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Aloys F Dornbracht GmbH & Co KG

Country of Origin: Germany

Brand: Dornbracht

Details of Fitting: 1/2" Thermostatic control valve

Model: 36.426.YYY.XX + 35.425.970.90
(where "YYY" denotes the code of series and "XX" denotes the variation in finishes)

Body Markings:



Expiry Date: 14 October 2024

This Authority hereby permits the use of the above fitting in fresh water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

"The cold water supply to the fitting shall be drawn from the same source that supplies the hot water apparatus so as to provide a balanced pressure and to obviate the risk of scalding in the event of a restriction or failure in the water supply." AND

"The shower head or handspray should not be placed in submerged conditions and should be securely fixed to the original position after use."

A condition of this acceptance is that the fitting to be installed shall be replicas of the sample as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fitting installed fails to meet that of the approved sample or if the fitting is found to be unsuitable for use in fresh water plumbing systems.

This acceptance is only applicable to the main body of the fitting, unless otherwise specified.

For the use of the fitting in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fitting by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,




(CHAN Chung-kun)

for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

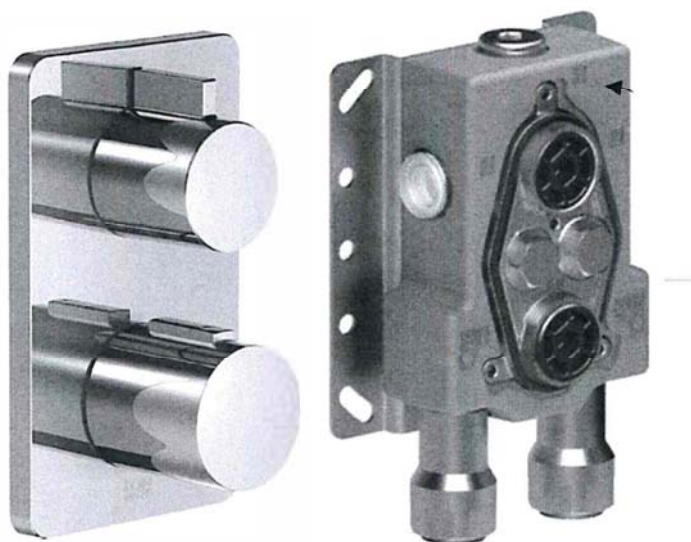

36.426.YYY.XX+35.425.970.90