



水務署
Water Supplies Department

總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (6) in WSD 3321/2020 T/J(514/2020)
Our ref.
來函檔號 :
Your ref.

電話 :
Tel.
傳真 : 2824 0578
Fax.

2 November 2020

**Approval of “MR” Ductile Iron Fittings
(General Acceptance No. C20200971)**

Your letters ref. DI.200511, DI.200612 and DI.200905 dated 11 May 2020, 12 June 2020 and 25 September 2020 respectively refer.

Having considered the test report ref. PMA00933 issued on 3 April 2020 by ETS-Testconsult Ltd. and WRAS certificate, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: XinFeng Pipe Fittings Co Ltd

Country of Origin: the Mainland of China

Brand: MR

Details of Fittings: Ductile iron fittings with epoxy powder coating under WRAS approval no. 1906535

Description	Size (mm)
Double Socket 90° Bend	80, 100, 150, 200, 250, 300, 350, 400, 450, 600
Double Socket 45° Bend	80, 100, 150, 200, 250, 300, 350, 400, 450, 600
Double Socket 22.5° Bend	80, 100, 150, 200, 250, 300, 350, 400, 450, 600
Double Socket 11.25° Bend	80, 100, 150, 200, 250, 300, 350, 400, 450, 600

Description	Size (mm)
Double Flanged 90° Bend	80, 100, 150, 200, 250, 300, 350, 400, 450, 600
Double Flanged 45° Bend	80, 100, 150, 200, 250, 300, 350, 400, 450, 600
Double Flanged 22.5° Bend	80, 100, 150, 200, 250, 300, 350, 400, 450, 600
Double Flanged 11.25° Bend	80, 100, 150, 200, 250, 300, 350, 400, 450, 600

Body Markings:

For Double Socket Bend:
MR BS EN545 DI K12 size x angle
(manufacture date)

For Double Flanged Bend:
MR BS EN545 DI K12 size x angle PN16
(manufacture date)

Expiry Date:

30 June 2024

This Authority hereby permits the use of the above fittings in fresh water plumbing systems, flushing water plumbing systems and fresh water fire services systems subject to full adherence to Waterworks installation requirements.

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fail to meet that of the approved samples or if the fittings are found to be unsuitable for use in the water supply systems mentioned above.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,



(CHAN Chung-kun)

for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82] - without catalogue
ME/MC] - with soft copy only




Double Socket 90° Bend



Double Socket 45° Bend



Double Socket 22.5° Bend

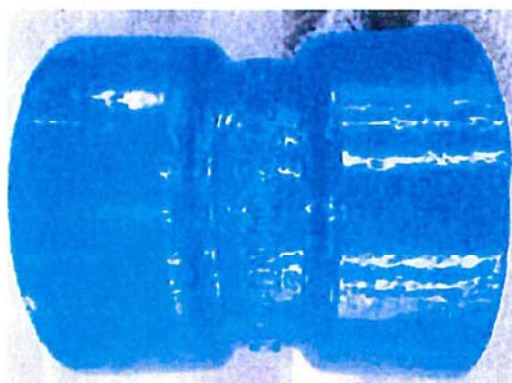

Double Socket 11.25° Bend



Double Flanged 90° Bend



Double Flanged 45° Bend



Double Flanged 22.5° Bend



Double Flanged 11.25° Bend