



水務署
Water Supplies Department

總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (2) in WSD 3321/2023 T/J(523/2023)
Our ref.
來函檔號 :
Your ref.

電話 :
Tel.
傳真 : 2824 0578
Fax.

19 June 2023

**Approval of “YUE HING” Float Valves
(General Acceptance No. C20230435)**

Your letter ref. WSD/AP-18052023-1 dated 18 May 2023 refers.

Brand	Model No. (Size)	Fugro Test Report Ref.	Issuance Date
Yue Hing	Y618C (80mm)	195044PC190352	21 Dec 2019
Yue Hing	Y618C (100mm)	195044PC190352(1)	21 Dec 2019
Yue Hing	Y618C (150mm)	195044PC190352(2)	21 Dec 2019

Having considered the above test reports issued by the Fugro Technical Services Limited and WRAS certificate, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Yue Hing Machine Factory Ltd

Country of Origin: the Mainland of China

Brand: Yue Hing

Details of Fitting: Cast iron equilibrium type float valve with epoxy coating under WRAS approval no. 2212528

Model: Y618C

Size: 80mm, 100mm, 150mm

Body Markings:  size in inch

Expiry Date: 29 November 2024

This Authority hereby permits the use of the above fittings in fresh water plumbing systems, flushing water plumbing systems and fresh water fire services systems subject to full adherence to Waterworks installation requirements.

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in the water supply systems mentioned above.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Ms Winnie LO at tel. no. 3583 4086.


Yours faithfully,



(Catlin Kit Wai, Stephen)
for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82] - without catalogue
ME/MC] - with soft copy only

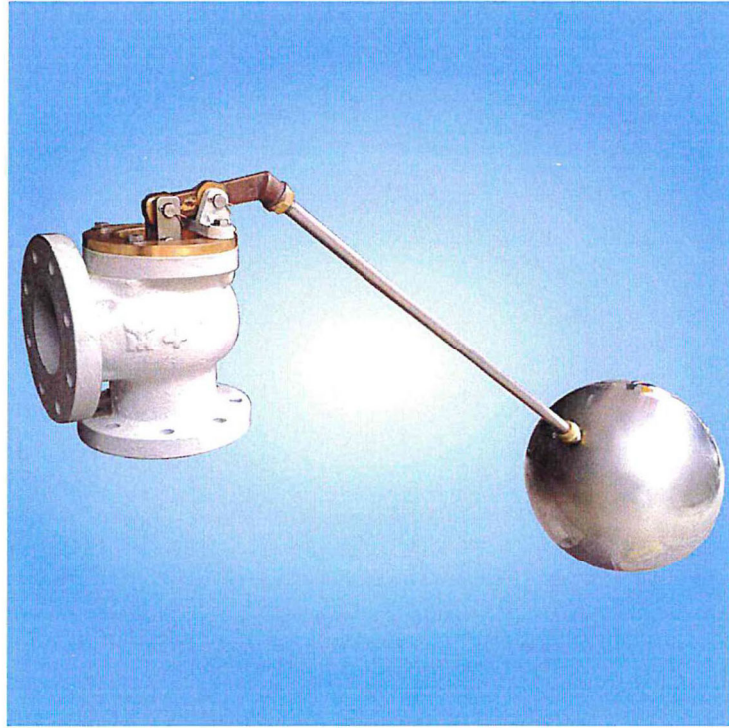

Y618C