



水務署
Water Supplies Department

總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (4) in WSD 3321/2024 T/J(138/2024)
Our ref.
來函檔號 :
Your ref.

電話 :
Tel.
傳真 : 2824 0578
Fax.

19 March 2024

**Approval of “ROCA” Sensor Flush Valves
(General Acceptance No. C20240191F)**

Your letters ref. D73A/2024/0078 and D73A/2024/0110 dated 5 February 2024 and 23 February 2024 respectively refer.

Having considered the test report ref. 236741PC233391A issued on 22 February 2024 by Fugro Technical Services Limited, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Roca Taiwan Co Ltd

Country of Origin: Taiwan, China

Brand: Roca

Details of Fitting: 1/2" Sensor flush valve for urinal

Model: 5A9702E0G, 5A9702A0G, 5A9702B0G,
5A9802E0G, 5A9802A0G, 5A9802B0G,
5A9602E0G, 5A9602C0G

Body Markings: 

Expiry Date: 18 January 2029

Proviso: As the fittings have not been tested for use in contact with water intended for human consumption, the fittings can only be used in flushing water plumbing systems.

This Authority hereby permits the use of the above fittings in flushing water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-

"Installation of filter before flushing valve is required. Without the filter, the flushing valve is liable to leak. The installed filter need frequent inspection and cleaning to maintain flushing supply. Normally only public toilets with good management system for maintenance would be considered."

"A stop cock or gate valve must be installed at the upstream of the fittings for manual isolation of water supply."

"The design flushing volume of the flushing valve should be compatible with the toilet bowl to ensure that effective clearance can be achieved by a single flush of water."

"Flushing valve should be used within the range of working pressures specified by the manufacturer." AND

"Installation of electronic opening and closing sanitary tapware should also comply with the requirements of Electrical & Mechanical Services Department."

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in flushing water plumbing systems.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer
Mr Albert CHOW at tel. no. 3583 4086.

Yours faithfully,




(Terry KUNG)


for Director of Water Supplies

Encl.



c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

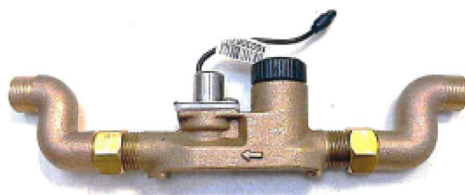

5A9702E0G / 5A9702A0G / 5A9702B0G

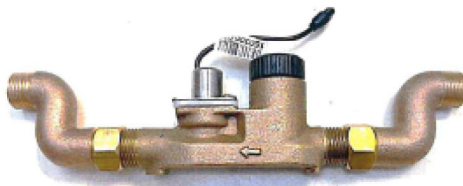

5A9802E0G / 5A9802A0G / 5A9802B0G

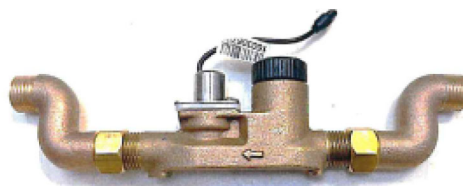

5A9602E0G / 5A9602C0G