



水務署

Water Supplies Department

香港灣仔告士打道七號入境事務大樓
Immigration Tower, 7 Gloucester Road, Hong Kong

電子郵件
e-mail wsdinfo@wsd.gov.hk

圖文傳真
Facsimile 2824 0578

檔號
Reference (4) in WSD 3611/13/98 Pt.8 T/J(58)

12 April 2018

**Application for Permission for Connection to a Main
“SAKURA” Instantaneous Gas Water Heaters
Models : H100RF(LPG), H100TF(LPG), H120TFL(LPG),
H120RFL(LPG), H120RFL(TG) and H100RF(TG)**

Your letters ref. L18001 and L18012 dated 16 January 2018 and 27 March 2018 respectively refer.

After examining the technical information, it is considered from water supply point of view that the captioned instantaneous gas water heaters are suitable for direct connection to waterworks mains subject to the following conditions:-

- (1) Name of Manufacturer: Taiwan Sakura Corporation
- (2) Country of Origin: Taiwan
- (3) Details of water heaters.

Model	Max. Working Pressure	Min. Working Pressure	Min. Working Water Flow
H100RF(LPG)	7 bar	0.2 bar	3.5 l/min
H100TF(LPG)	7 bar	0.2 bar	3.5 l/min
H120TFL(LPG)	7 bar	0.2 bar	3.5 l/min
H120RFL(LPG)	7 bar	0.2 bar	3.5 l/min

Model	Max. Working Pressure	Min. Working Pressure	Min. Working Water Flow
H120RFL(TG)	7 bar	0.2 bar	3.5 l/min
H100RF(TG)	7 bar	0.2 bar	3.5 l/min

- (4) The water heaters are not suitable for use in drinking water purpose.
- (5) You are required to ensure that these water heaters should also comply with the requirements of Electrical & Mechanical Services Department.
- (6) Installation of the heaters must be in full compliance with the conditions stipulated in Part 4 of Schedule 2 of Waterworks Regulations, Chapter 102A. Your particular attention is drawn to that the heaters are required to have a guaranteed test pressure of at least 1.5 times the static head available at the heaters.
- (7) Expiry Date : 16 August 2022 (for model H100RF(LPG))
17 August 2022 (for model H100TF(LPG))
20 August 2022 (for model H120TFL(LPG))
21 August 2022 (for model H120RFL(LPG))
21 September 2022 (for model H120RFL(TG))
24 September 2022 (for model H100RF(TG))

This letter should not be regarded as a certification/approval on the construction, quality, durability, efficiency etc. of the water heaters as these aspects should remain to be the manufacturer's guarantee. The permission given by this letter will be withdrawn if the water heaters are found to be unsuitable for use in fresh water plumbing systems.

Proviso: Our permission is based on the condition that the water heaters will be installed individually. If such heaters are to be installed in series or in parallel with other heaters, submission of plumbing proposal for each individual project to the Water Authority for approval is required and off-tank may be needed. Notwithstanding the above, you are required to ensure that the water heaters should also comply with the requirements of Electrical & Mechanical Services Department.

Should you have any enquiries, please contact our Engineer Mr Terry KUNG at tel. no. 3583 4086.

Yours faithfully,

A handwritten signature in black ink, appearing to be 'Chan Chung Kun', written in a cursive style.

(CHAN Chung Kun)
for Water Authority


c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only




H100RF(LPG) / H100RF(TG)



H100TF(LPG)

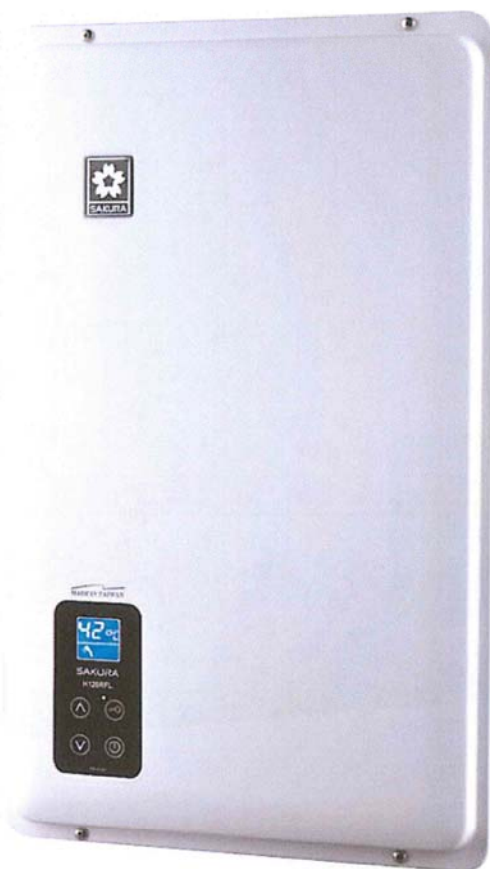

H120RFL(LPG) / H120RFL(TG)

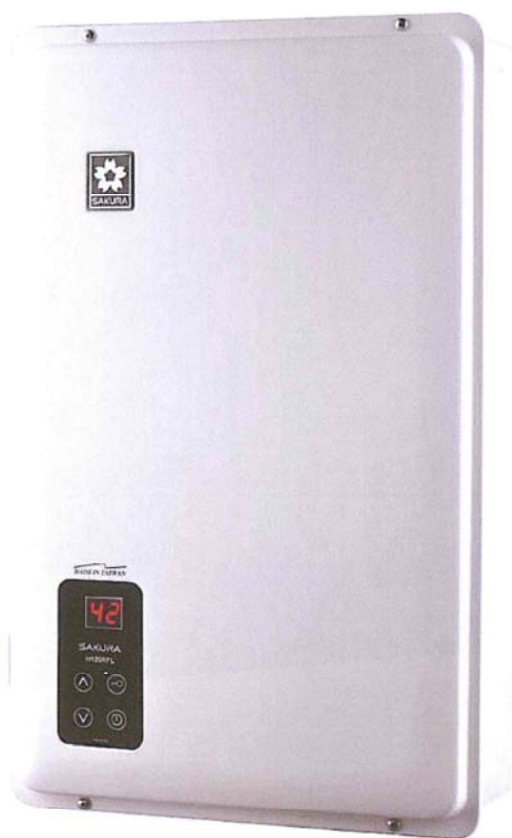

H120TFL(LPG)