



水務署
Water Supplies Department

總部 Headquarters

香港灣仔告士打道七號入境事務大樓 48 樓

48/F, Immigration Tower, 7 Gloucester Road, Wan Chai, Hong Kong

本署檔號 : (2) in WSD 3611/11/96 Pt.26 T/J(15)
Our ref.
來函檔號 :
Your ref.

電話 :
Tel.
傳真 : 2824 0578
Fax.

6 March 2020

**Application for Permission for Connection to a Main
“GEISAR” Instantaneous Electric Water Heaters
(General Acceptance No. H20200004)**

Your letter ref. APP200112 dated 12 January 2020 refers.

After examining the technical information, it is considered from water supply point of view that the captioned instantaneous electric water heaters are suitable for direct connection to waterworks mains subject to the following conditions:-

- (1) Name of Manufacturer: Foshan Shunde JNOD Electrical Appliance Co Ltd
- (2) Country of Origin: the Mainland of China
- (3) Details of water heaters.

Model	Max. Working Pressure	Min. Working Pressure	Min. Working Water Flow
GSW309MD	6 bar	0.2 bar	3 l/min
GSW312MD	6 bar	0.2 bar	3 l/min
GSW315MD	6 bar	0.2 bar	3 l/min
GSW318MD	6 bar	0.2 bar	3 l/min
GSW321MD	6 bar	0.2 bar	3 l/min
GSW324MD	6 bar	0.2 bar	3 l/min
GSW327MD	6 bar	0.2 bar	3 l/min



香港環境卓越大獎
Hong Kong Awards for Environmental Excellence



- (4) The water heaters are not suitable for use in drinking water purpose.
- (5) You are required to ensure that these water heaters should also comply with the requirements of Electrical & Mechanical Services Department.
- (6) Installation of the heaters must be in full compliance with the conditions stipulated in Part 4 of Schedule 2 of Waterworks Regulations, Chapter 102A. Your particular attention is drawn to that the heaters are required to have a guaranteed test pressure of at least 1.5 times the static head available at the heaters.
- (7) Expiry Date : 23 March 2022

This letter should not be regarded as a certification/approval on the construction, quality, durability, efficiency etc. of the water heaters as these aspects should remain to be the manufacturer's guarantee. The permission given by this letter will be withdrawn if the water heaters are found to be unsuitable for use in fresh water plumbing systems.

Proviso: Our permission is based on the condition that the water heaters will be installed individually. If such heaters are to be installed in series or in parallel with other heaters, submission of plumbing proposal for each individual project to the Water Authority for approval is required and off-tank may be needed. Notwithstanding the above, you are required to ensure that the water heaters should also comply with the requirements of Electrical & Mechanical Services Department.

Should you have any enquiries, please contact our Engineer Mr. Terry KUNG at tel. no. 3583 4086.

Yours faithfully,




(CHAN Chung-kun)

for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only

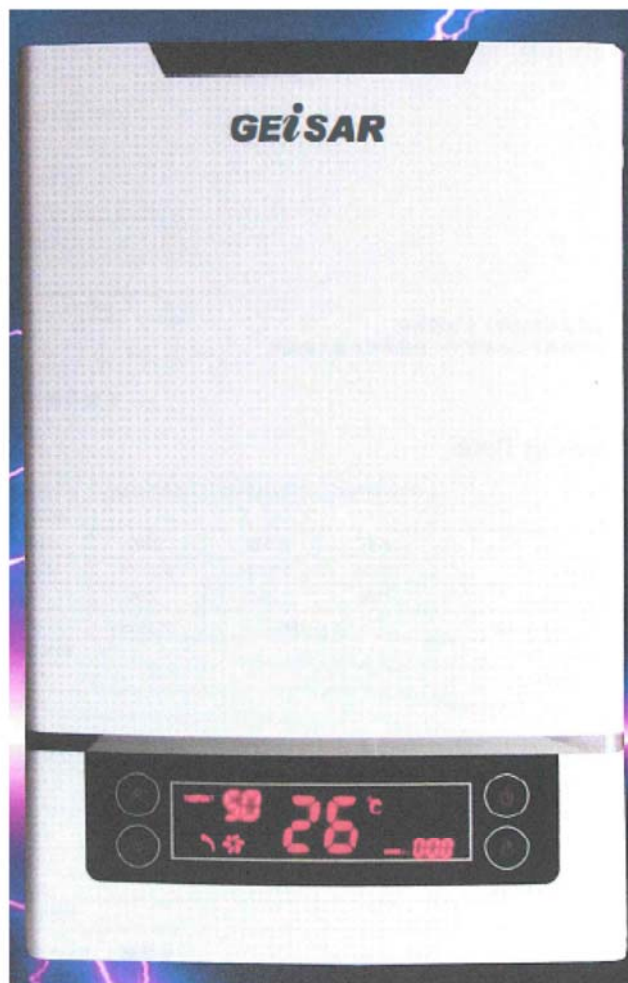

GSW309MD / GSW312MD / GSW315MD /
GSW318MD / GSW321MD / GSW324MD /
GSW327MD