



水務署  
Water Supplies Department

香港灣仔告士打道七號入境事務大樓  
Immigration Tower, 7 Gloucester Road, Hong Kong.

電子郵件  
e-mail      wsinfo@wsd.gov.hk

電話  
Telephone

圖文傳真  
Facsimile      2824 0578

檔號  
Reference      ( 10 ) in WSD 3321/2025 T/J(177/2025)

2 July 2025

**Approval of “GAPEX” PE Fittings  
(General Acceptance No. ZC20250456)**

Your letter ref. GA2K25-L0304-WSD dated 4 March 2025 and subsequent submissions received by this department up to 16 June 2025 refer.

Having considered the test reports ref. PMA50394 issued on 27 February 2025 by ETS-Testconsult Limited and ref. J28514Cr3 issued on 13 June 2025 by Nutek Systems (HK) Limited, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

**Name of Manufacturer:** Jilin Song Jiang Smart Joint Co Ltd

**Country of Origin:** the Mainland of China

**Brand:** Gapex

**Details of Fittings:** PE fittings in blue colour (PE100, SDR11)

| Description                | Size (mm)                    |
|----------------------------|------------------------------|
| Electrofusion 90° Elbow    | 32, 63, 125, 180, 250        |
| Electrofusion 45° Elbow    | 63, 125, 180                 |
| Electrofusion Reducing Tee | 32x25x32, 63x32x63, 90x63x90 |
| Electrofusion Reducer      | 50x32, 63x32, 125x90         |



**Body Markings:** GAPEX BS EN 12201 W/P  
Nominal size PE100 SDR11 PN16  
Product Description Batch No.

**Expiry Date:** 1 July 2030

This Authority hereby permits the use of the above fittings in fresh water plumbing systems and flushing water plumbing systems subject to full adherence to Waterworks installation requirements.

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in the water supply systems mentioned above.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Mr Albert CHOW at tel. no. 3583 4086.

Yours faithfully,



(Terry KUNG)

for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82 ] - without catalogue  
ME/MC ] - with soft copy only




Electrofusion 90° Elbow



Electrofusion 45° Elbow



Electrofusion Reducing Tee

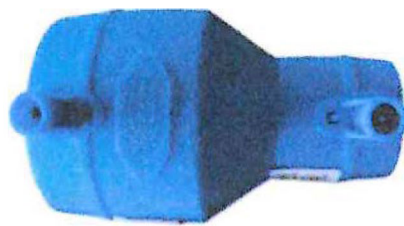

Electrofusion Reducer