



水務署
Water Supplies Department

香港灣仔告士打道七號入境事務大樓
Immigration Tower, 7 Gloucester Road, Hong Kong.

電子郵件
e-mail

wsdinfo@wsd.gov.hk

電話
Telephone

圖文傳真
Facsimile

2824 0578

檔號
Reference

(6) in WSD 3321/2025 T/J(1155/2025)

3 March 2026

**Approval of “KURIMOTO” Ductile Iron Fittings
(General Acceptance No. ZC20260132)**

Your letter ref. 1136/2025 dated 14 November 2025 and subsequent submissions received by this department up to 3 February 2026 refer.

Having considered the test reports ref. PMA52342 issued on 11 November 2025, ref. PMA52343A issued on 24 December 2025, ref. PMA52344B issued on 28 January 2026 & ref. AGA50538 issued on 23 December 2025 by ETS-Testconsult Ltd. and WRAS certificate, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Kurimoto Ltd

Country of Origin: Chinese Mainland

Brand: Kurimoto

Details of Fittings: Ductile iron fittings with internal cement mortar lining under WRAS approval no. 2207526

Description	Size (mm)
All Flanged Tee PN16	80x80x80, 100x100x80, 100x100x100, 150x150x80, 150x150x100, 150x150x150, 200x200x80, 200x200x100, 200x200x150, 200x200x200, 250x250x250, 300x300x300



東江水供港



香港環境卓越大獎
Hong Kong Awards for Environmental Excellence



15 years+ 同心展關懷
caring organisation
Awarded by the Hong Kong Council of Social Service
香港社會服務會頒發

Description	Size (mm)
All Flanged Tee PN25	80x80x80, 100x100x80, 100x100x100, 150x150x100, 150x150x150
Double Flanged Taper PN16	80x50, 100x80, 150x80, 150x100, 200x150, 250x200, 300x250
Double Flanged 90° Bend PN16	150, 200, 250, 300
Double Flanged 45° Bend PN16	150, 200, 250, 300
Double Flanged 90° Bend PN25	80, 100, 150, 200
Double Flanged 45° Bend PN25	80, 100, 150, 200
Double Flanged 22.5° Bend PN16	80, 100, 150, 200, 250, 300
Double Flanged 11.25° Bend PN16	80, 100, 150, 200, 250, 300

Body Markings:

For Double Flanged Bends:

X BS EN 545 K12 (PN) size x angle

For Others:

X BS EN 545 K12 (PN) size x size**Expiry Date:**

2 March 2031


This Authority hereby permits the use of the above fittings in fresh water plumbing systems, flushing water plumbing systems and fresh water fire services systems subject to full adherence to Waterworks installation requirements.

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in the water supply systems mentioned above.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Mr Albert CHOW at tel. no. 3583 4086.

Yours faithfully,




(CHAN Kwok Leung, Douglas)
for Director of Water Supplies

Encl.

c.c. WSD 3321/1/82] - without catalogue
 ME/MC] - with soft copy only



All Flanged Tee PN16

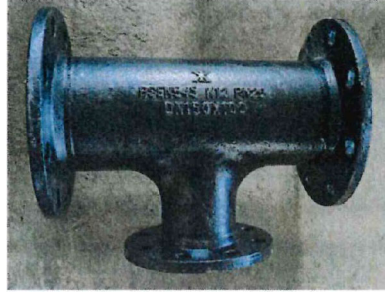

All Flanged Tee PN25



Double Flanged Taper
PN16



Double Flanged 90°
Bend PN16



Double Flanged 45°
Bend PN16



Double Flanged 90°
Bend PN25



Double Flanged 45°
Bend PN25



Double Flanged 22.5°
Bend PN16



Double Flanged 11.25°
Bend PN16