



水務署
Water Supplies Department

香港灣仔告士打道七號入境事務大樓
Immigration Tower, 7 Gloucester Road, Hong Kong.

電子郵件
e-mail wsdinfo@wsd.gov.hk

電話
Telephone

圖文傳真
Facsimile 2824 0578

檔號
Reference (2) in WSD 3321/2026 T/J(449/2026)

7 July 2026

**Approval of “GROHE” Flexible Hoses
(General Acceptance No. ZC20260454)**

Your E-Application [file-id: ETJ-GA-20260424-195] dated 15 May 2025 and subsequent submission received by this department on 5 June 2026 refer.

Having considered the test report ref. 252852WA252204A issued on 5 June 2026 by Fugro Technical Services Limited, this Authority accepts that the fittings described below comply with, and their use when correctly installed does not contravene, the Waterworks Ordinance and Regulations.

Name of Manufacturer: Grohe AG

Country of Origin: Bulgaria

Brand: Grohe

Details of Fitting: Stainless steel braided inlet flexible hose for tap/mixer

Model: 429723999G, 429724999G, 429772999G, 429774999G

Size: Bore diameter: 6mm
End connection: 3/8"

Body Markings:  



Expiry Date: 6 July 2031

This Authority hereby permits the use of the above fittings in fresh water plumbing systems subject to full adherence to Waterworks installation requirements. In particular, you are required to draw your customers' attention to the following requirement-


"The inlet flexible hose is applied for the water tap or mixer connection only and installed in the fresh water plumbing systems."

A condition of this acceptance is that the fittings to be installed shall be replicas of the samples as certified by the testing agent mentioned above and without modifications. This acceptance may be withdrawn at any time if the standard of the fittings installed fails to meet that of the approved samples or if the fittings are found to be unsuitable for use in fresh water plumbing systems.

For the use of the fittings in any project, the General Acceptance Number of this letter must be quoted as a means of identification of acceptance of the fittings by this Authority.

Should you have any enquiries, please contact our Engineer Mr Albert CHOW at tel. no. 3583 4086.


Yours faithfully,




(CHAN Kwok Leung, Douglas)
for Director of Water Supplies

Encl.


c.c. WSD 3321/1/82] - without catalogue
ME/MC] - with soft copy only

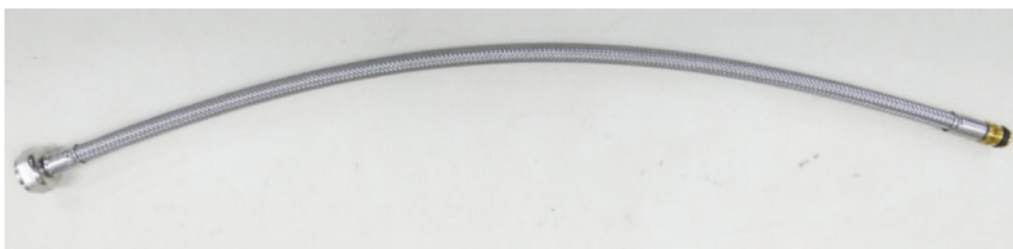


429723999G

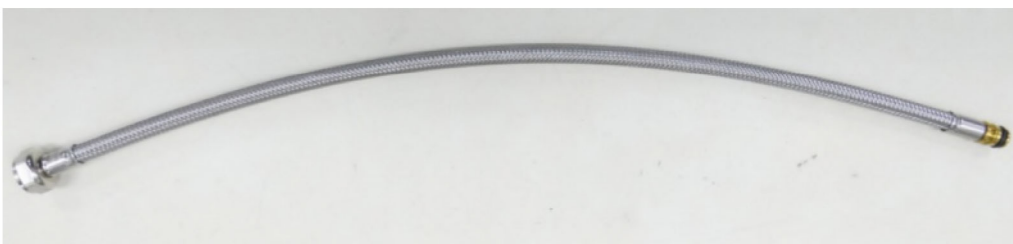

429724999G

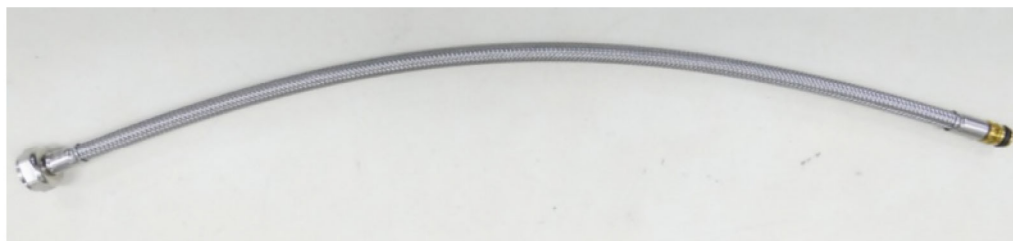

429772999G

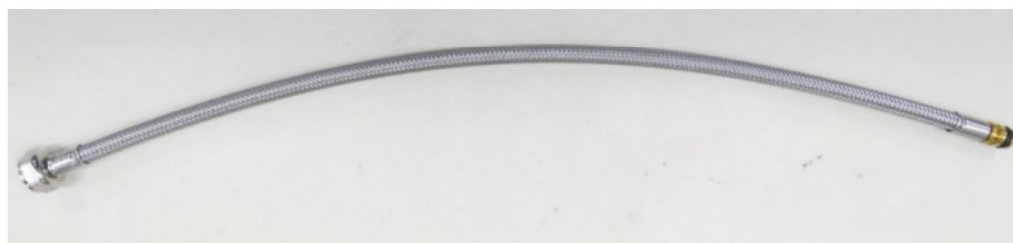

429774999G